

Miami-Dade Water & Sewer Department



Sea Level Rise and Climate Change: Water Modeling Advances and Capital Resilience Planning November 16, 2016

Florida Water and Climate Alliance Workshop

Virginia Walsh, Ph.D., P.G.
Chief Hydrogeology Section
Miami-Dade Water and Sewer Department

Miami-Dade Water and Sewer Department (WASD)

- Largest Water & Sewer Utility in the Southeastern United States
- Serving more than 2.3 million residents
- FY2015-2016 Budget:
 - Projected Revenues \$732 Million
 - \$13.5 Billion Multi-Year Capital Plan (FY16-21)
 - 2626 Total Budgeted Positions



Miami-Dade Water and Sewer Department (WASD) Overview

- Largest water and sewer utility in Florida, serving more than 2.2 million residents
- Water System:
 - 3 large regional and 5 small water treatment plants
 - Supplying an average of 304 million gallons per day
 - 90% of the County's public water supply
 - Per capita water use 137 gpcd
 - 100 water supply wells
 - Biscayne Aquifer
 - Floridan Aquifer
 - Aquifer Storage and Recovery
 - 7,918 miles of pipes
 - 38,381 fire hydrants
 - 126,913 valves




WASD Overview

- **Wastewater System:**

- 3 wastewater treatment plants
- 2 ocean outfalls (3 and 7 miles from coast) and 21 deep injection wells (~2,500 ft depth)
- Collecting, treating, and disposing 316 MGD
- 6,292 miles of mains and laterals
- 1,042 sewer pumps stations (operated)
- Reusing 10.2 MGD



Miami-Dade Water and Sewer Department Water & Wastewater Treatment Facilities

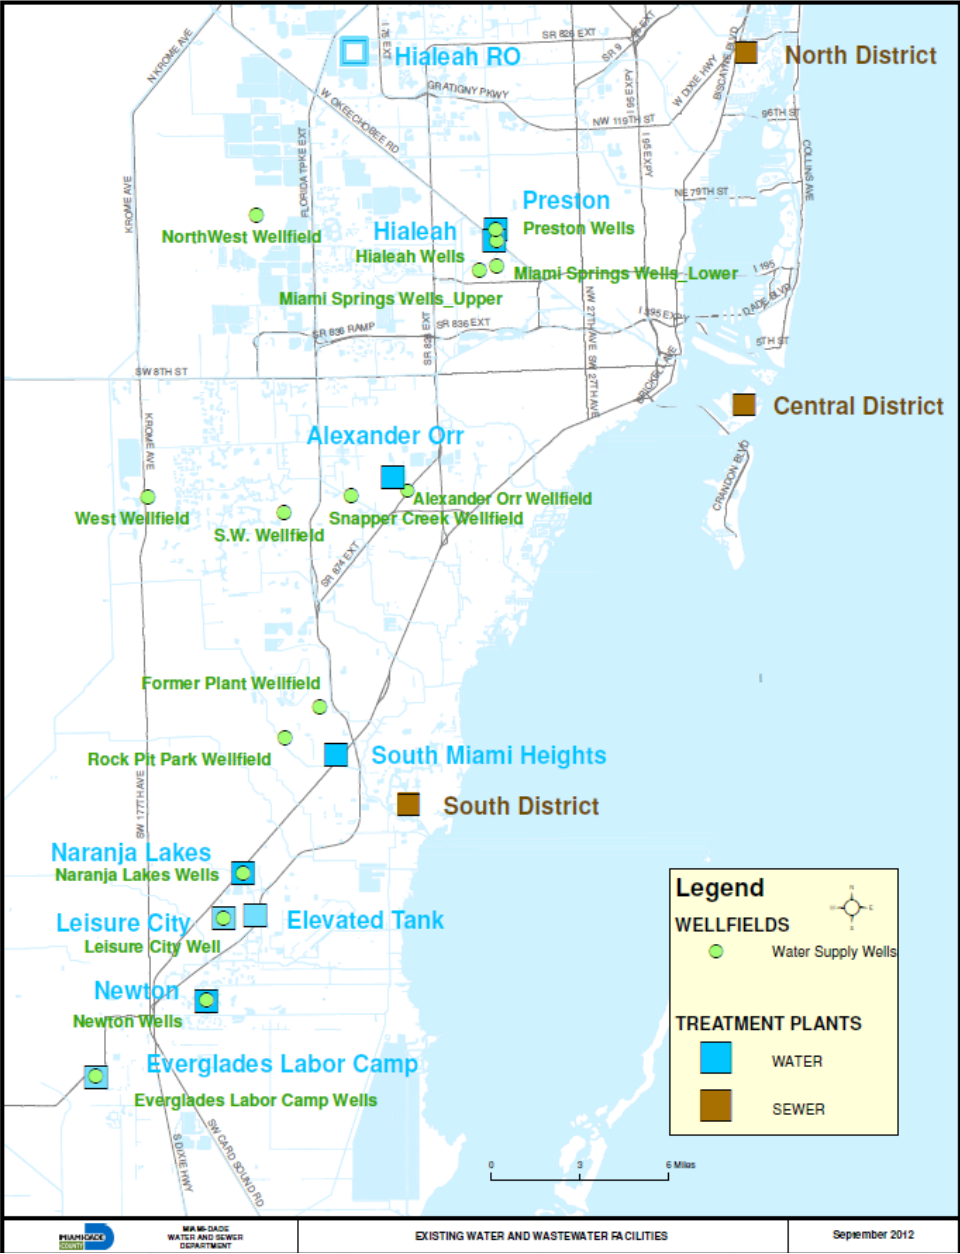

Miami-Dade County entered into a Joint Funding Agreement (JFA) with the USGS in February 2008 in response to the South Florida Water Management District 20-Year Water Use Permit (WUP)

U.S. Geological Survey United States Department of the Interior	MIAMI-DADE COUNTY
USGS Point of Contact	Customer Point of Contact
Name: Jean Happel Address: 3110 S. W. 9th Avenue Fl. Lauderdale, FL 33315 DJINS #: 137784026 Telephone: 954.377.5932 Email: jhappel@usgs.gov	Name: Virginia Walsh, P.G. Address: 3071 S. W. 38th Avenue Room 554-10 Miami, FL 33146 Telephone: 786.552.5266 Email: WALSHV@miamidade.gov
Signatures	Signatures
By:  Date: 12/04/07 Name: Dr. Henry Roosen Title: FISC Director	By:  Date: _____ Name: _____ Title: _____
By: _____ Date: _____ Name: _____ Title: _____	 By:  Date: 01/06/2008 Name: ABBARADO Title: Deputy Clerk

One of the objectives of the model is to evaluation of sea level rise (SLR):

An Integrated Model of Surface and Groundwater Flow for Evaluating the Effects of Competing Water Demands in Miami-Dade County
A Proposal Prepared by the U.S. Geological Survey
November 29, 2007

Problem Statement

1. How much impact do well-fields have on surface and groundwater flows to Biscayne Bay?
2. What areas recharge the municipal well fields?
3. Do canal management practices or well-field withdrawals increase water losses from Everglades National Park?
4. Could the Biscayne aquifer be better managed by changing well-field operation or canal management practices?
5. Where are the most effective locations to apply reuse water?

6. Will sea-level rise cause saltwater intrusion into coastal well fields?

7. Can well-field operation be optimized to meet hydrologic constraints, such as those mandated for the Northwest Wellfield?
8. What are the impacts of lake excavations on area wide groundwater flows and saltwater intrusion?
9. What are the impacts to the groundwater flow regime if lakes are filled?



Prepared in cooperation with the Miami-Dade Water and Sewer Department

Documentation of the Surface-Water Routing (SWR1) Process for Modeling Surface-Water Flow with the U.S. Geological Survey Modular Groundwater Model (MODFLOW-2005)

Chapter 40 of
Section A, Groundwater
Book 6, Modeling Techniques



Techniques and Methods 6-A40

U.S. Department of the Interior
U.S. Geological Survey



Prepared in cooperation with the Miami-Dade Water and Sewer Department


Hydrologic Conditions in Urban Miami-Dade County, Florida, and the Effect of Groundwater Pumpage and Increased Sea Level on Canal Leakage and Regional Groundwater Flow



Scientific Investigations Report 2014-5162

U.S. Department of the Interior
U.S. Geological Survey



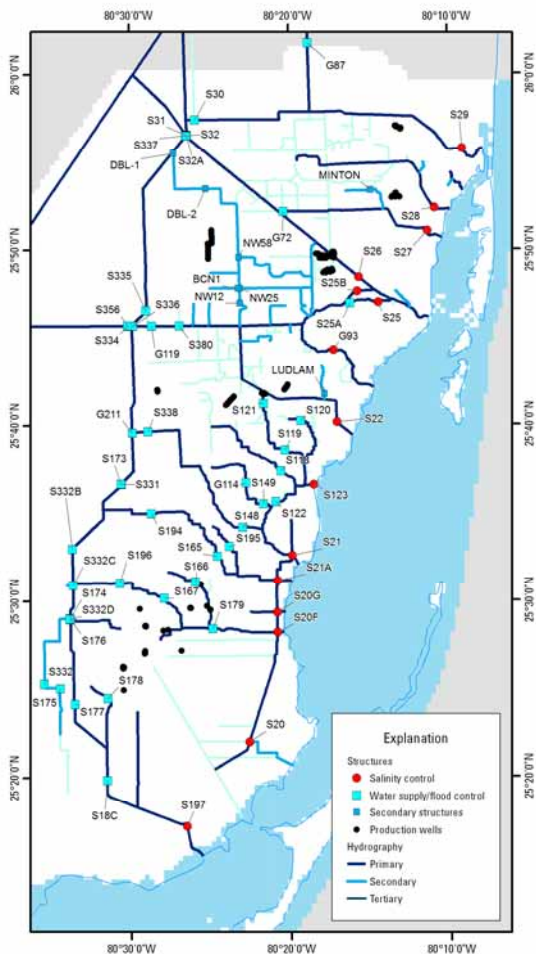


Surface-water system Managed system used to control urban flooding

supply recharge to municipal well fields
control saltwater intrusion


66 operable primary and secondary Canal surface water control structures



- Time-varying surface water component (SWR1 Process)
- 2,352 discretized reaches and 637 reach groups
- 1,009 unique trapezoidal cross sections
- 61 primary and 12 secondary canal surface-water structures using specified gate opening data
- Everglades Depth Estimation Network (EDEN) data used to define upstream stage in C-304 and L-29 canal in WCA3B
- Virginia Key tidal data used to define downstream stage for all canals connected to Biscayne Bay

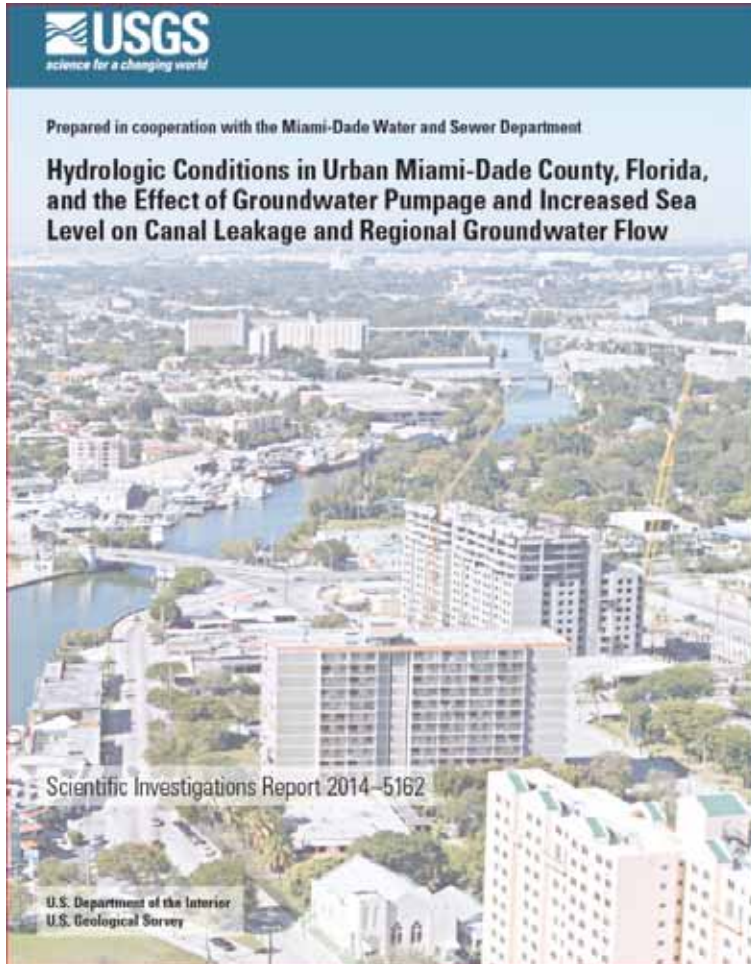

*Scientifically defensible
at this point in time
with available SLR and
climate change data
available*

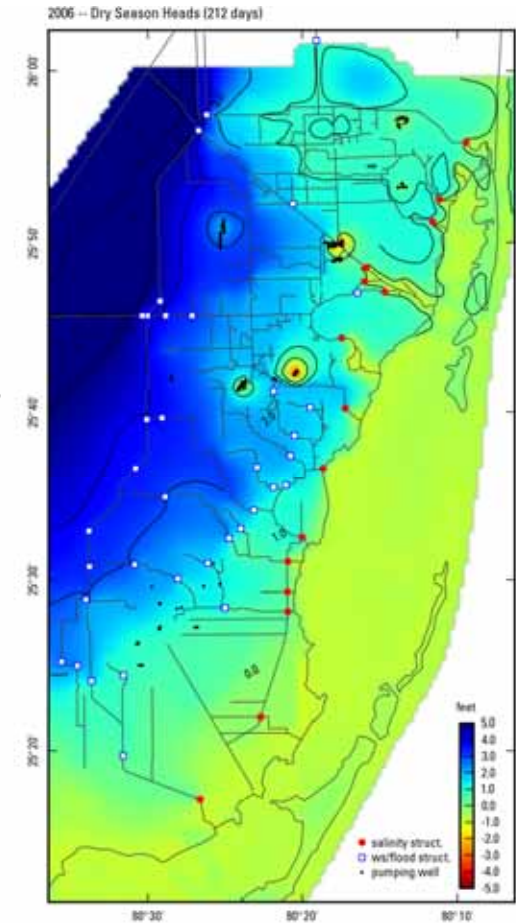


<http://pubs.er.usgs.gov/publication/sir20145162>

- Simulation period from 1/1/1996 to 12/31/2010
 - **30-year scenario simulation period representing conditions from 2011 through 2040**
 - **NRC III rate of 1.23 ft increase over 30 years**
 - **Assumed current climatic conditions**



Miami-Dade County in Cooperation with the US Geological Survey has one of the most technically advanced monitoring network for Salt Water Intrusion in the World

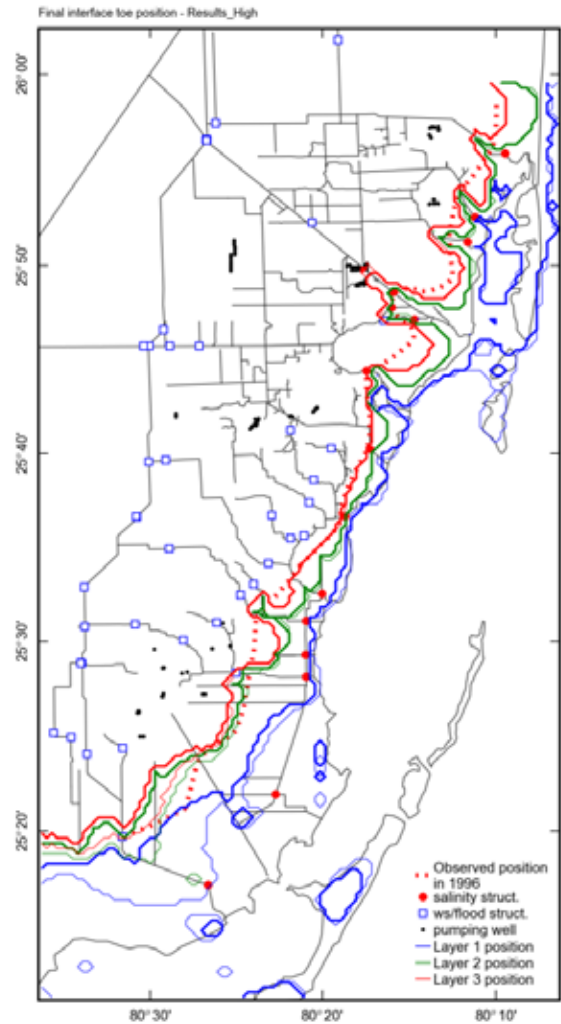

Model result 2040 end of Dry Season – Scenario 2

Hazen and Sawyer

Miami Springs Wellfield:

integrating science into operations

EDP SPECIAL REQUEST SCOPE
EDP-WS-SR-211
Hazen and Sawyer, P.C.

Background

The Miami Dade Water and Sewer Department (MDWASD) operates the Preston and Hialeah Water Treatment Plants (WTP) which process raw water from the Biscayne Aquifer. These facilities utilize fine sand filtration processes to remove hardness present in the raw water prior to re-aeration, filtration, disinfection, air stripping, and finished water storage. The Preston and Hialeah WTPs were constructed in 1968 and 1974, respectively, with several upgrades and expansions since initial commissioning. Given their age, condition and level of treatment, both plants have been considered candidates for process upgrades and redesign in recent years. Several other facilities also currently supply the MDWASD system including the City WTP, Hialeah LLP WTP, and several smaller "Pump and Treat" systems in the southern portion of the service area. A new plant, the South Miami Heights WTP, is also in the final stages of design. This interconnected treatment system provides approximately 300 mgd to the system on an average daily basis.

Purpose

The purpose of this Task Authorization is for Hazen and Sawyer, P.C. (ENGINEER) to evaluate the specific repair, replacement and process upgrade needs of the Preston and Hialeah WTPs to achieve compliance with potential future regulatory requirements. These requirements include the possibility of the wellfields being declared groundwaters under the direct influence of surface water (DWSUD). This task authorization also includes a review of the specific need for the new Northwest Wellfield Water Treatment (NWWWTP).

Scope

Task 1 – Data Collection and Document Review

Task 6 – Analysis of Potential Hydrogeochemical Impacts on Preston and Hialeah WTP Wellfields

ENGINEER will perform an analysis of USGS Urban Miami-Dade County Surface/Groundwater Model future scenario results for salt water intrusion and groundwater elevation changes (up to 30 years in future and NRC III SLR). This analysis will consider existing and future water treatment requirements along with wellfield operations for Hialeah/Preston with respect to USGS model results.

MDWASD will provide the USGS model files and associated software (to be published in Sept). The intent is to take the model results and apply them to the operational conditions in wellfield and at the water treatment plants in this study. The objective is to determine the need to modify the model to best establish operational planning. Results of the model analysis will be used to determine effectiveness of existing water treatment plants process and when system will require upgrades for degrading water quality. Results will also be used to estimate how long Miami Springs and Plant-site wellfields will pump fresh water (i.e., less than 500 mg/L TDS). Potential flooding impacts on water quality and operations will be considered as well.

Deliverable: Technical Memorandum presenting findings, conclusions and recommendations.




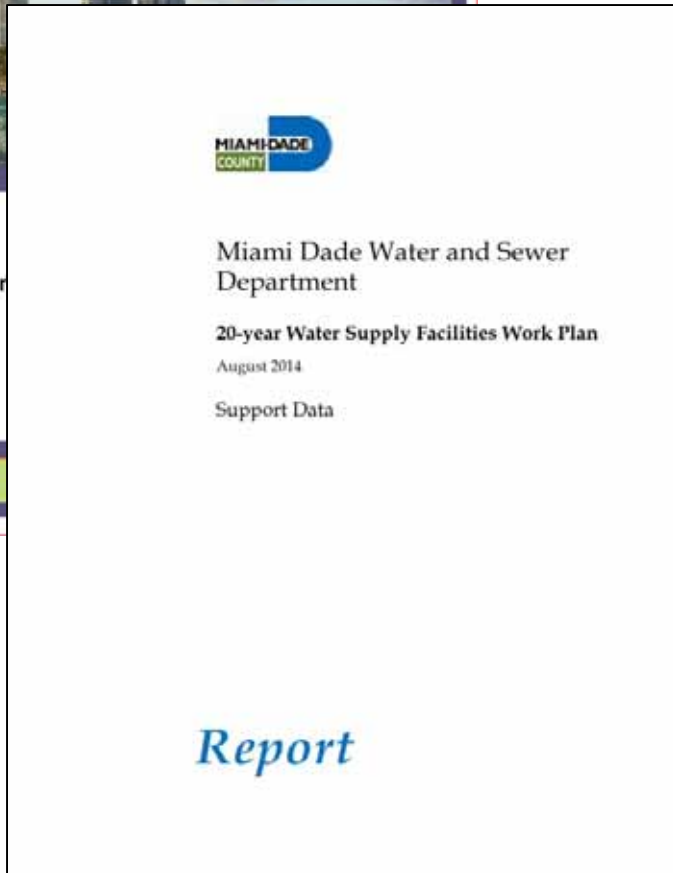


	Table of Contents Water Facilities Work Plan
4.5.2.2	City of North Miami Beach..... 4-7
4.5.2.3	City of Homestead..... 4-8
4.5.2.4	Florida City..... 4-8
4.6	Summary..... 4-8
Section 5 Planned Water Supply Facilities	
5.1	Alternative Water Supply Projects..... 5-1
5.1.1	Hialeah Floridan Aquifer R.O. W.T.P..... 5-5
5.2.1.1	Hialeah Floridan Aquifer R.O. W.T.P. Phase 1-a (7.5 MGD)..... 5-5
5.2.1.2	Hialeah Floridan Aquifer R.O. W.T.P. Phase 1-b (2.5 MGD)..... 5-5
5.1.2	South Miami Heights WTP and Wellfield (20 MGD)-17.45 MGD Floridan Aquifer RO and 2.55 MGD Biscayne Aquifer..... 5-5
5.2	Miscellaneous Projects..... 5-6
5.2.1	Water Conservation/Non-Revenue Potential Water Loss Reduction Program (up to 19.62 MGD)..... 5-6
5.3	20-Year Work Plan and Capital Improvement Plan..... 5-6
5.4	Other Water Suppliers Future Plans..... 5-7
5.4.1	City of North Miami..... 5-7
5.4.2	City of North Miami Beach..... 5-7
5.4.3	City of Homestead..... 5-7
5.4.4	Florida City..... 5-7
5.5	Conclusion..... 5-8
Section 6 Climate Change and Sea Level Rise Plan	
6.1	Introduction..... 6-1
6.2	Miami-Dade County Sea Level Rise and Climate Change: Recent Government Action..... 6-2
6.3	Saltwater Intrusion..... 6-3
6.3.1	Salt Intrusion Monitoring Network..... 6-4
6.4.1	Salt Intrusion Front Delineation..... 6-5
6.4	Urban Miami-Dade County Surface Water/Groundwater Model..... 6-7
6.5	Extreme Weather Events..... 6-11
6.6	Infrastructure Assessment..... 6-11
	References..... 6-13
Tables	
2-1	Wholesale Water Agreements for 20 Year Period..... 2-7
3-1	Biscayne Aquifer Wellfield Data..... 3-5
3-2	Floridan Aquifer Wellfield Data..... 3-2
3-3	Hialeah-Proton Finished Water Storage Facilities..... 3-13
3-4	MDWASD Facilities Capacities..... 3-19
3-5	Other Suppliers' Facilities Capacities..... 3-20
	iv

Climate change and SLR assessment is now a critical component of Water and Sewer Department (WASD) planning



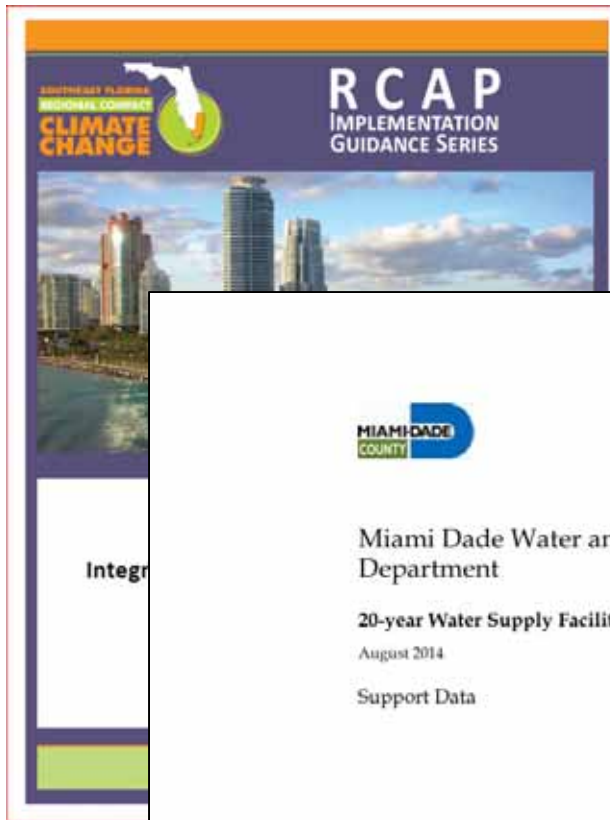


Executed by the Counties in 2010

The Compact calls for the Counties to work cooperatively to:


- Develop annual Legislative Programs and jointly advocate for state and federal policies and funding
- Dedicate staff time and resources to create a Southeast Florida Regional Climate Action Plan to include mitigation and adaptation strategies
- Meet annually in Regional Climate Summits to mark progress and identify emerging issues.



<http://www.southeastfloridaclimatecompact.org/wp-content/uploads/2015/10/2015-Compact-Unified-Sea-Level-Rise-Projection.pdf>

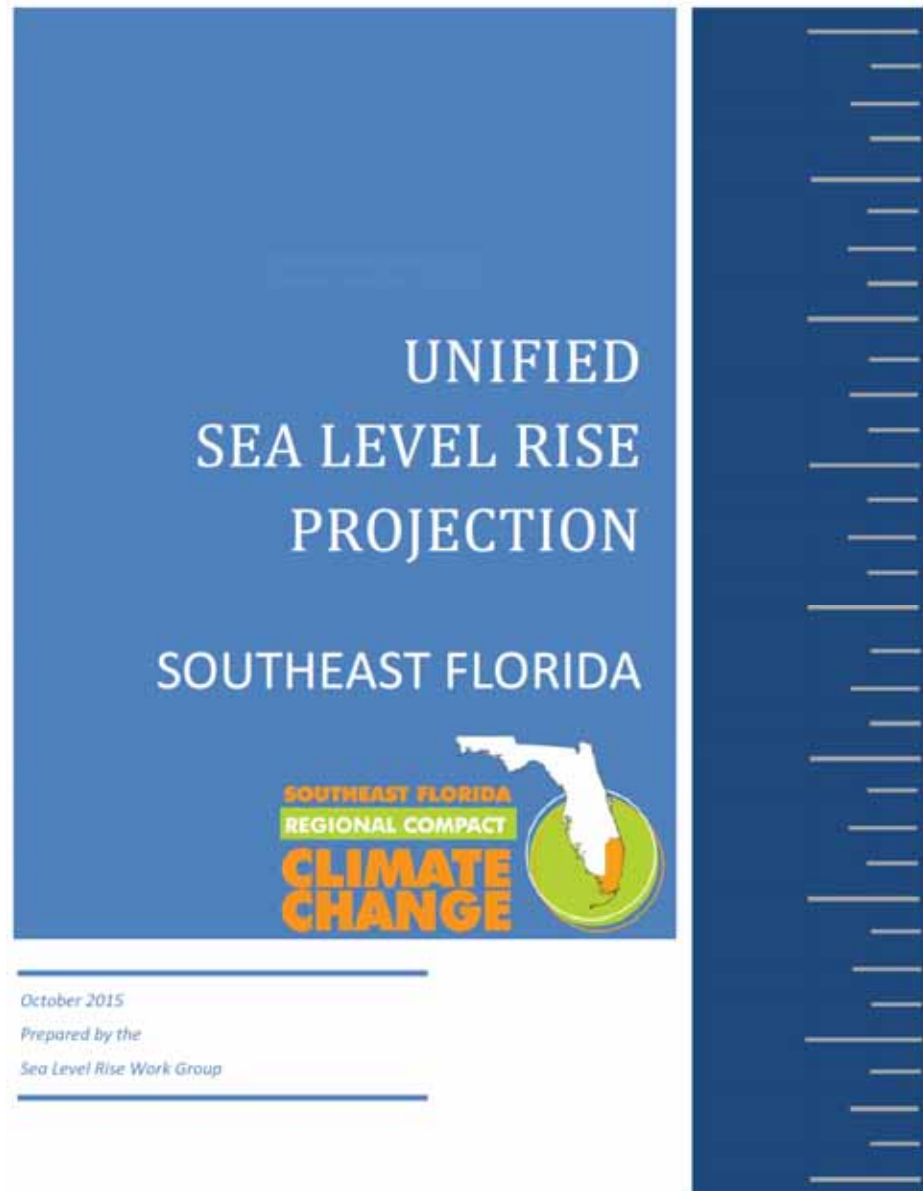


WASD's Capital Improvement Program \$13.5 billion

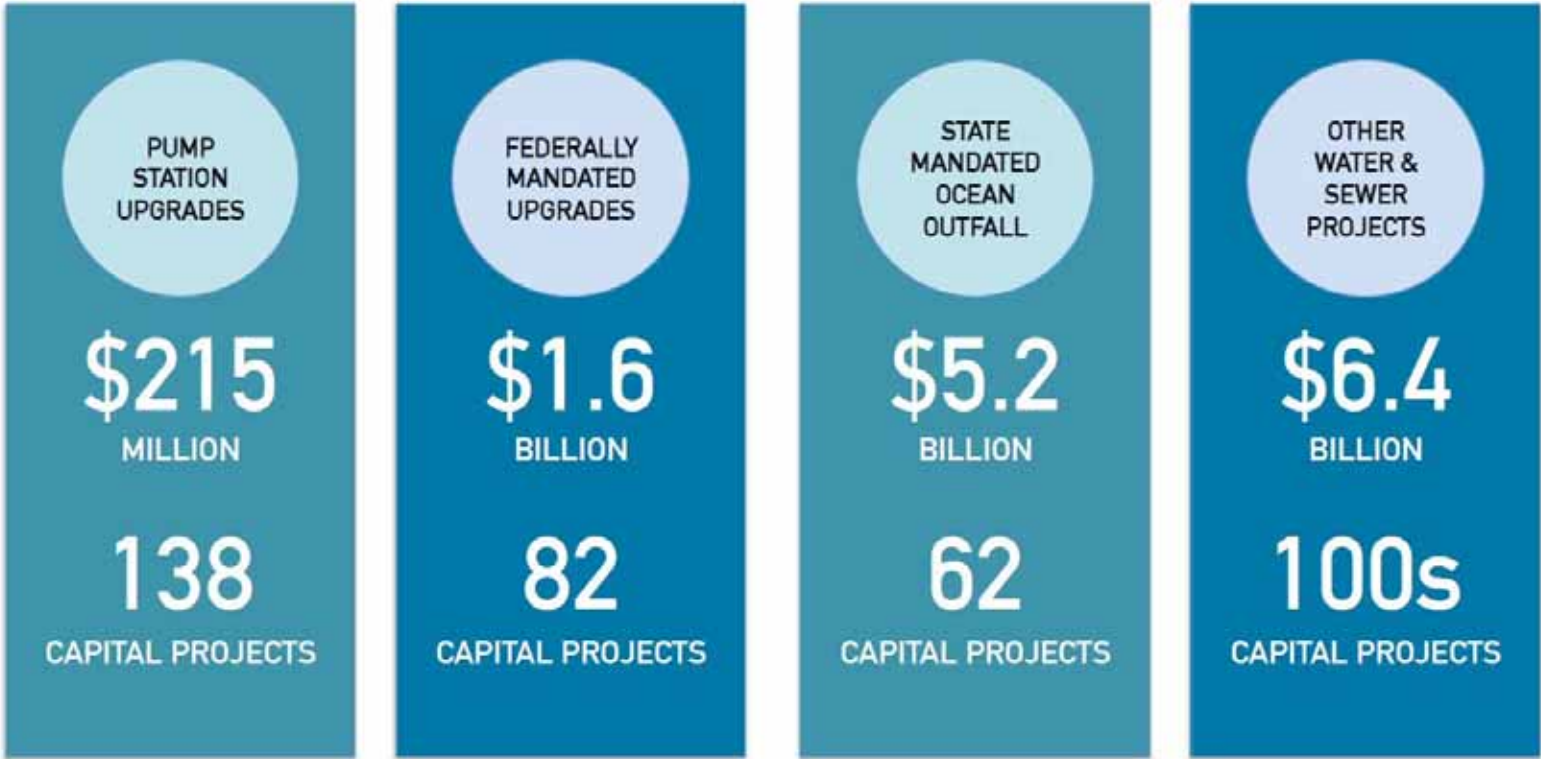


50 year life cycle for critical infrastructure



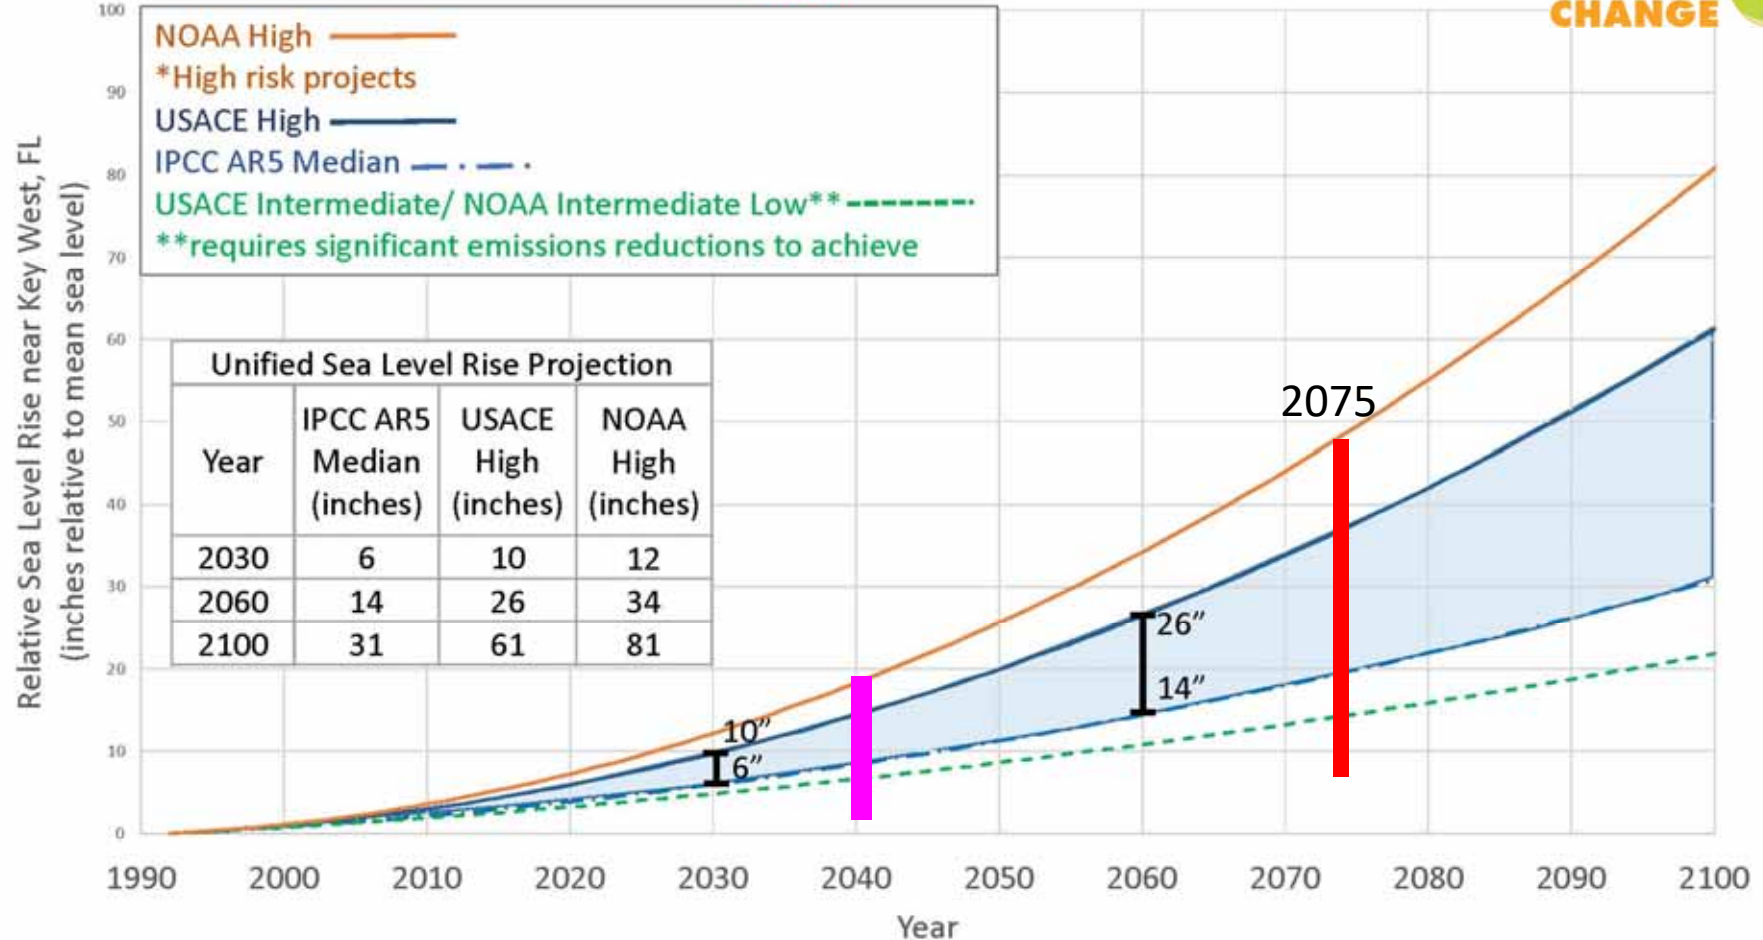


IN PROGRESS: Updated data sets
Updated SLR projection curves (2015 USLRP)
Running Model Scenarios out to year 2075

Initial Sea Level Rise Assessments WASD Facilities

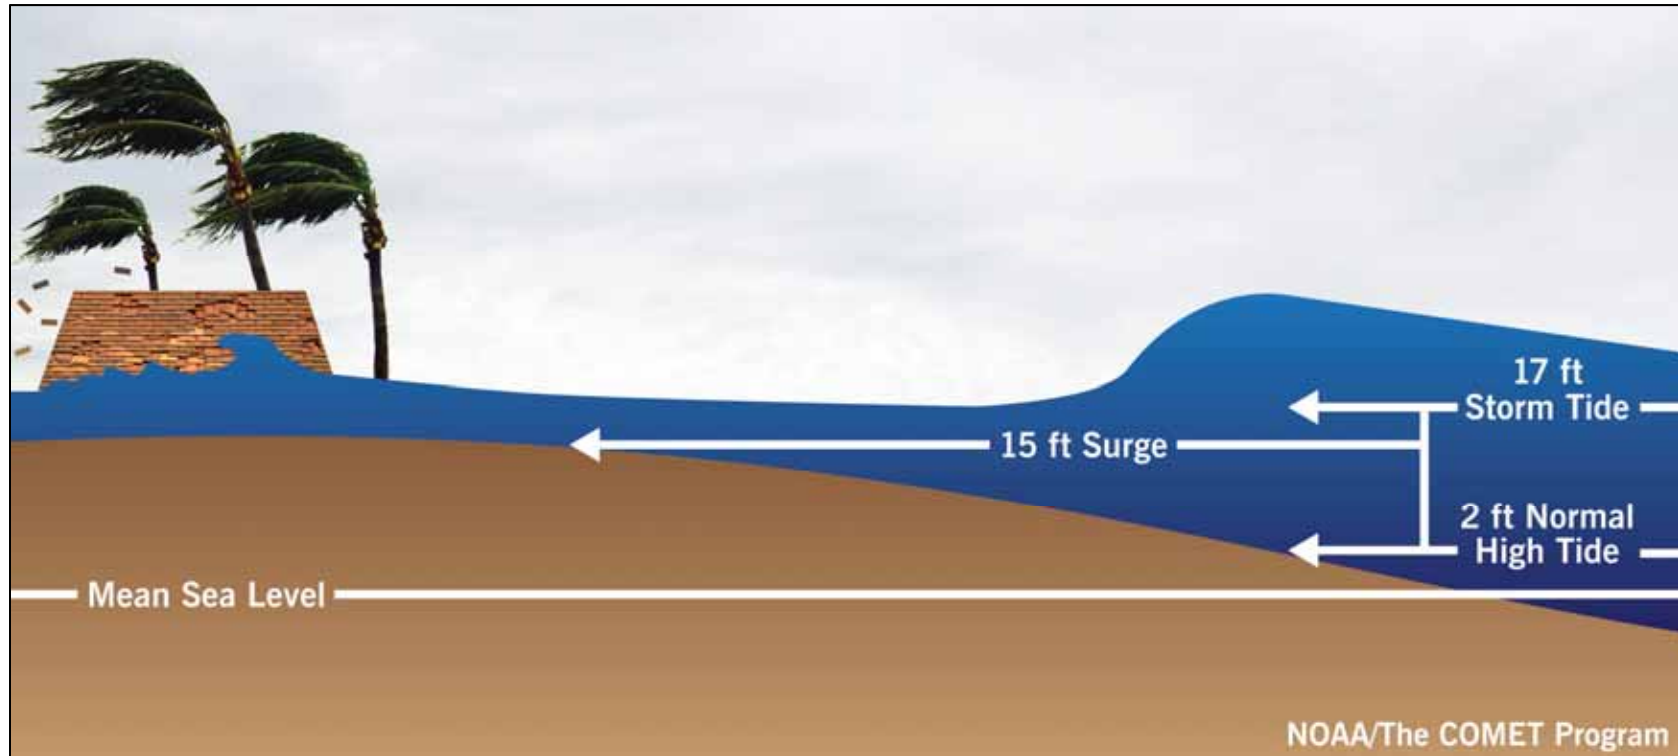

Storm Surge and Tide = Storm Tide

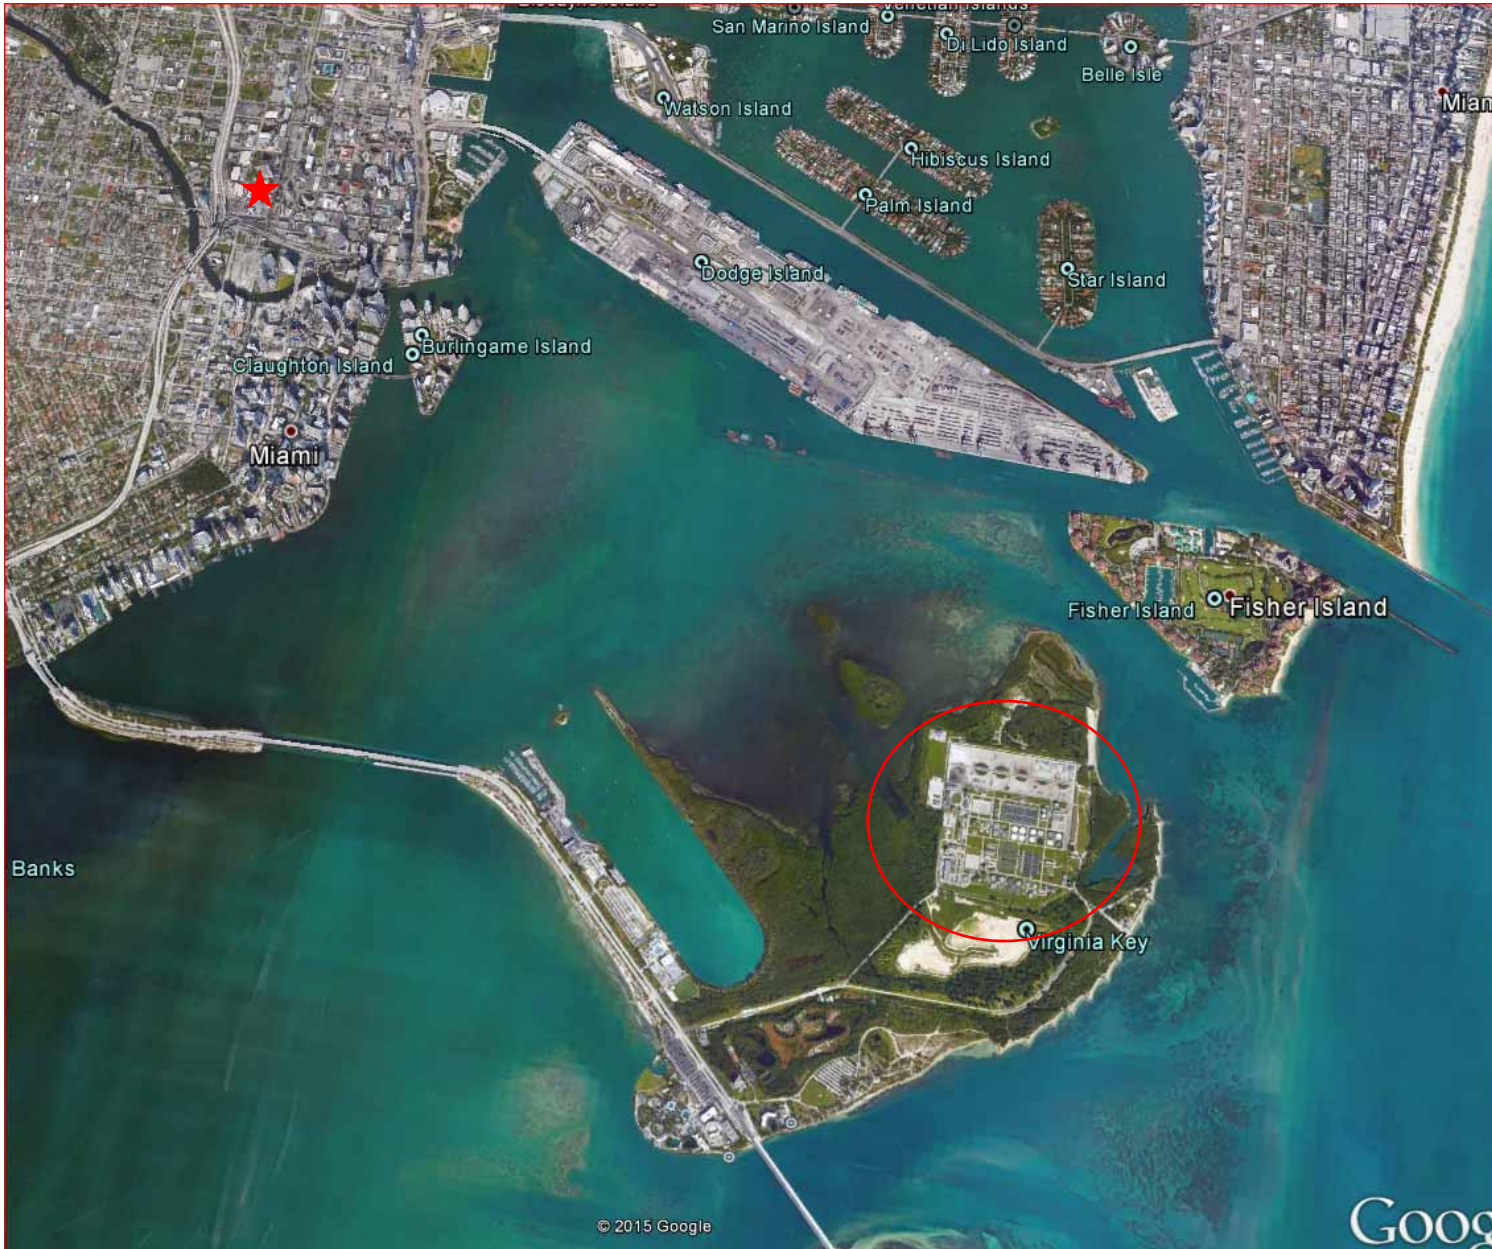

Central District Wastewater Treatment Plant



WASD

Design Guidance on Facility Hardening with Climate Change

- Climate Change Stressors and Impacts:
 - Heat
 - Rainfall
 - Sea Level Rise
 - Storm Surge (Wind and Pressure)
- WASD Guidance for Facility Hardening
 - Planning horizon
 - Safety Factors



WASD Guidance on Key Climate Variables for Scenario Analysis

- **Planning Horizon:**

- 2075 for Critical Long-Term Facilities (e.g. WWTPs)
- 2040 selected for pump station flows

- **Climate scenarios:**

- Greenhouse Gas Scenario: RCP – 8.5
- GCM ensemble upper bound - 90% non-exceedance


- **Design storms:**

- 2-year 24-hr
- 10-year 24-hr
- 100-year 24-hr



- **Sea Level Rise:**

- NOAA (High) projection for critical facilities
- USACE (high) projection for others



- Surge and inundation modeling run with 1.23 m (48") SLR (2075 NOAA High).

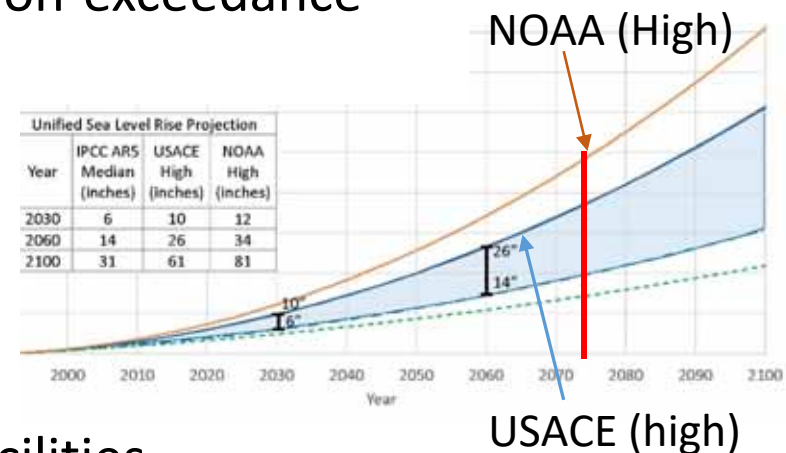

Andrew is the storm of record August 1992

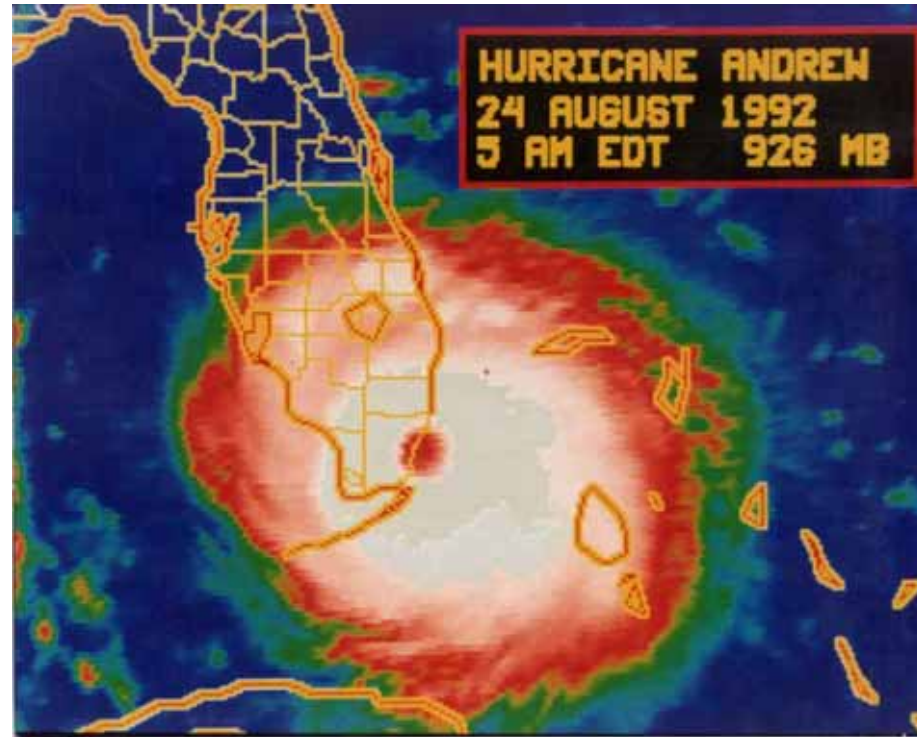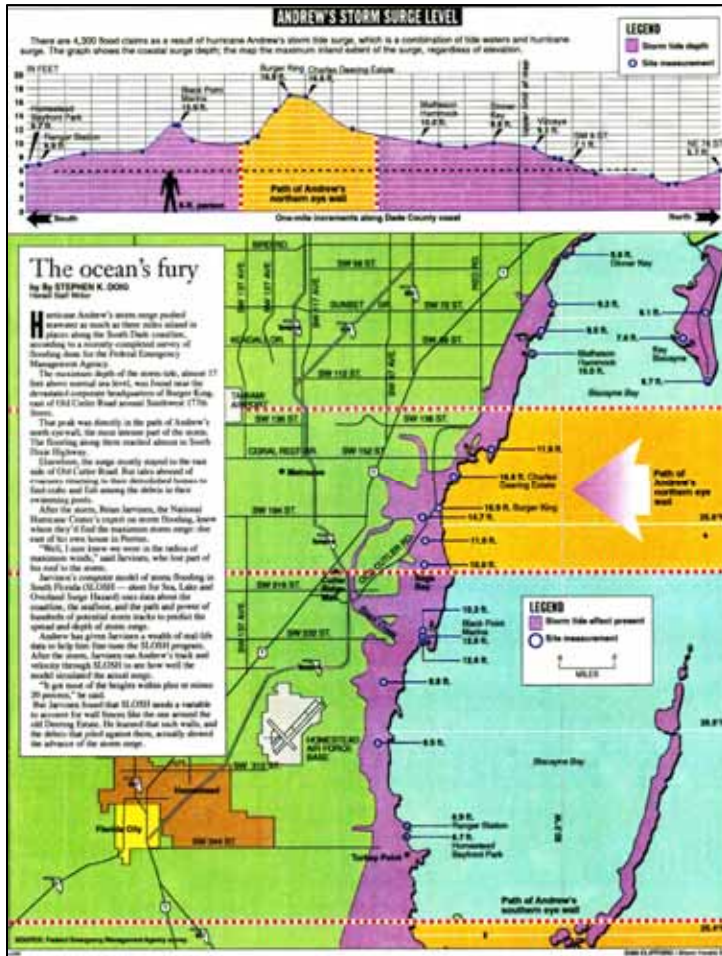


Stressor: Storm Surge with Sea Level Rise Impacts: Coastal Flooding

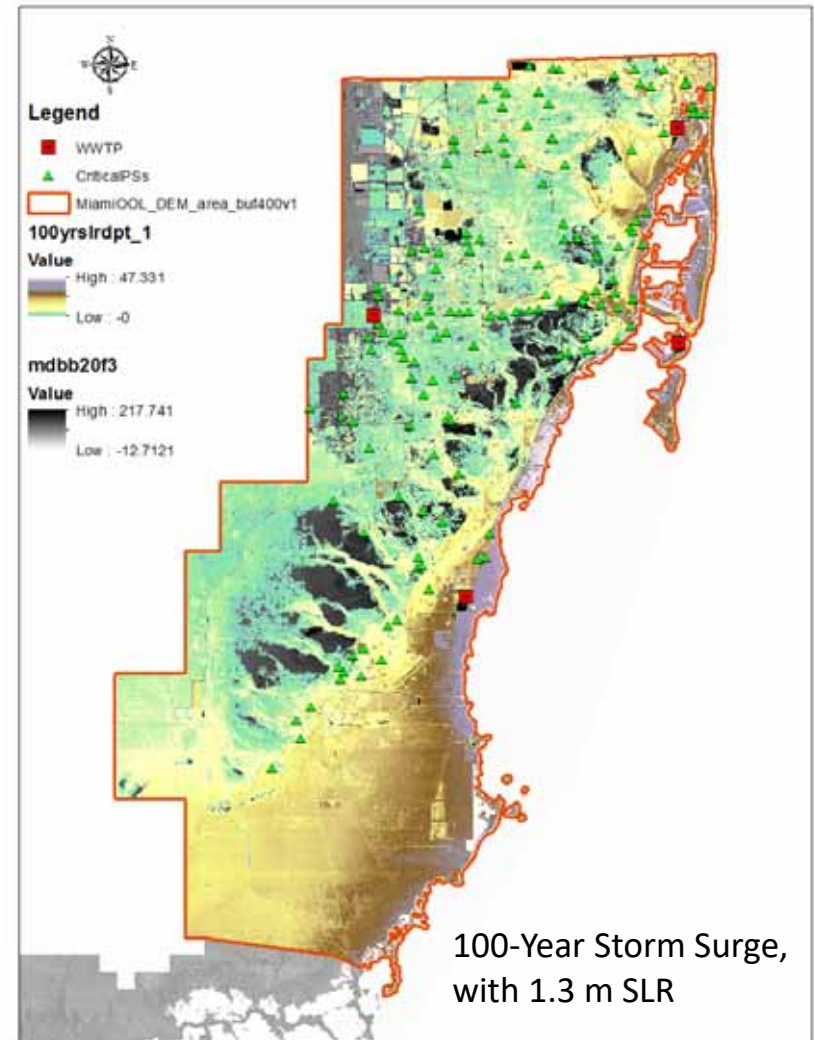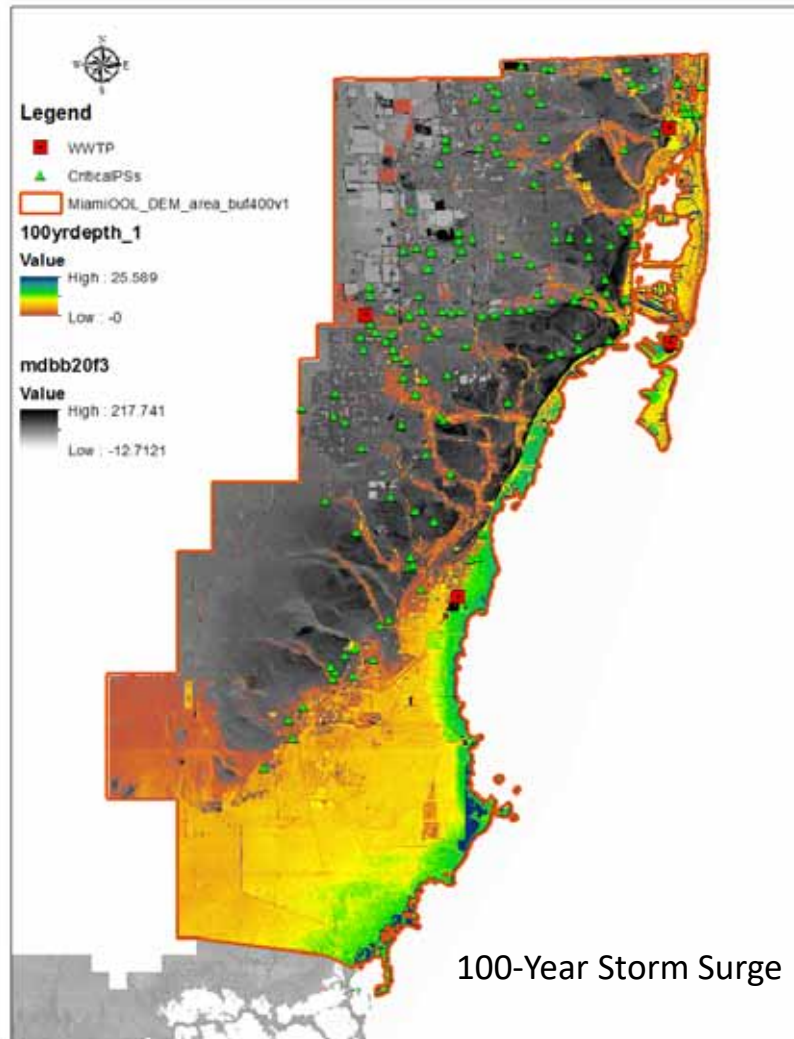

Source: CH2M, 2015

Facility Hardening Design Elevations and Prioritization of Critical Facilities for Central District Wastewater Treatment Plant.

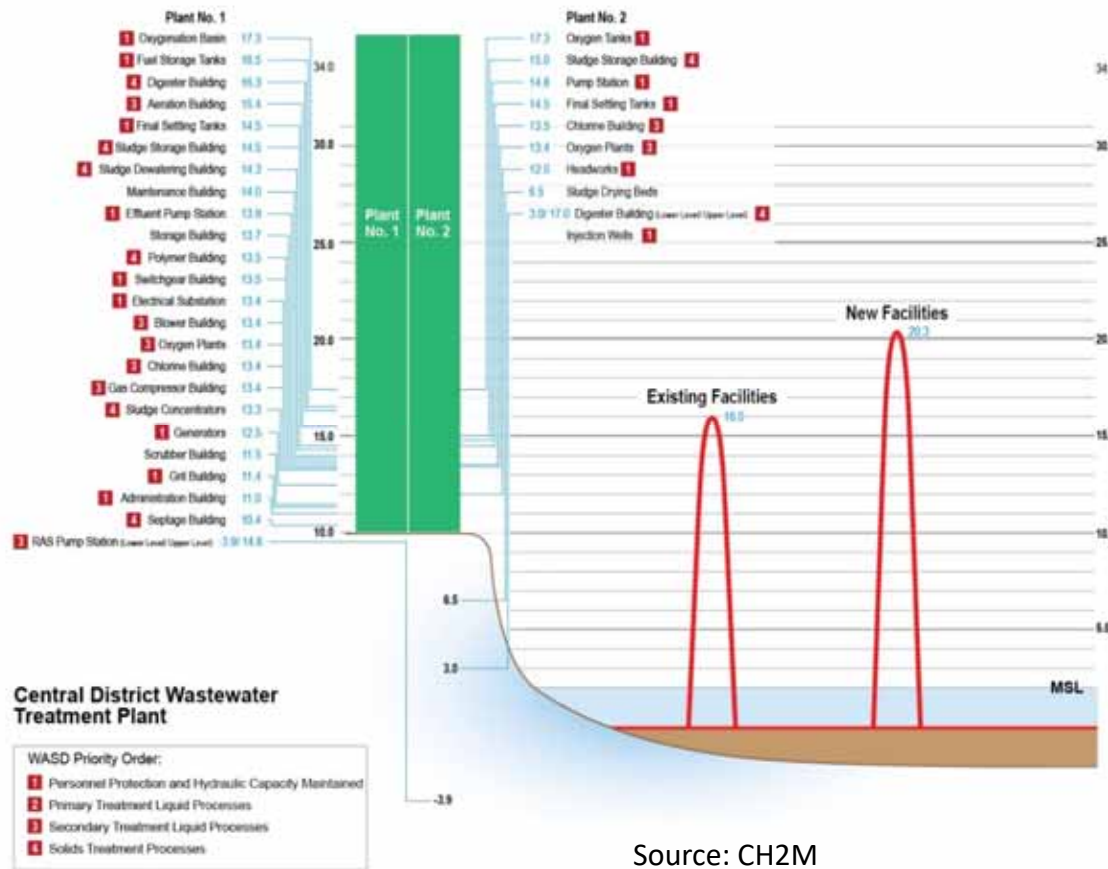

Level of Service Priorities for Facility Resilience during Extreme Events

1. Personnel protection and hydraulic capacity maintained.
2. Primary treatment liquid processes
3. Secondary treatment liquid processes
4. Solids treatment processes

OCEAN OUTFALL LEGISLATION PROGRAM
Draft

**Design Guide for Hardening Wastewater
Pump Station Facilities against Flooding
from Surge, Sea Level Rise, and
Extreme Rainfall**

OCEAN OUTFALL LEGISLATION PROGRAM
Draft

**Design Guide for Hardening Wastewater
Treatment Facilities against Flooding
from Surge, Sea Level Rise, and
Extreme Rainfall**

Prepared for
Miami-Dade Water and Sewer Department

August 2015

Prepared by
ch2m
3150 SW 38 Ave., Suite 700
Miami, Florida 33146-1531

- summarizes elevations below which wastewater treatment facility assets should be protected or hardened to withstand or recover from:
 - flooding from projected future combinations of storm surge from tropical storms and hurricanes
 - extreme rainfall
 - sea level rise (SLR)
- Risk-based framework to guide the design of wastewater facilities for extreme events
- Recognizes that these extreme events are low probability, but potentially high consequence if systems fail.

The Office of Resilience

Department of Regulatory and Economic Resources / Office of Resilience

100 Resilient Cities

100 Resilient Cities is a global effort to build resilience in 100 of the world's most vulnerable cities. Miami-Dade County is one of the 100 cities.

Greater Miami and the Beaches is the only city in the world to be named a 100 Resilient City. The City of Miami Beach is also a 100 Resilient City.

What is Urban Resilience? It is the ability of a city to withstand and recover from a disaster or other crisis. It is the ability of a city to adapt to a changing environment.

Benefits of being a 100 Resilient City include:

- Increased resilience to natural disasters
- Increased resilience to economic shocks
- Increased resilience to social and environmental challenges
- Increased resilience to climate change
- Increased resilience to infrastructure challenges
- Increased resilience to public health challenges
- Increased resilience to transportation challenges
- Increased resilience to energy challenges
- Increased resilience to water challenges
- Increased resilience to food and agriculture challenges
- Increased resilience to housing challenges
- Increased resilience to community development challenges
- Increased resilience to cultural and creative industries challenges
- Increased resilience to tourism challenges
- Increased resilience to international trade and investment challenges
- Increased resilience to global challenges

www.miamidade.gov

Department of Regulatory and Economic Resources / Office of Resilience

Sea Level Rise Taskforce

Sea Level Rise - Task Force is a group of experts who are working to develop a plan to address the risks of sea level rise in Miami-Dade County.

Sea Level Rise - Urban Resilience is a program that is helping cities to become more resilient to sea level rise.

Progress on the Recommendations include:

- Developing a Sea Level Rise Resilience Plan
- Improving the resilience of critical infrastructure
- Improving the resilience of the transportation system
- Improving the resilience of the water supply system
- Improving the resilience of the energy system
- Improving the resilience of the food and agriculture system
- Improving the resilience of the housing system
- Improving the resilience of the community development system
- Improving the resilience of the cultural and creative industries system
- Improving the resilience of the tourism system
- Improving the resilience of the international trade and investment system
- Improving the resilience of the global system

www.miamidade.gov

Department of Regulatory and Economic Resources / Office of Resilience

Adaption Action Areas

Moving ahead with Adaption Action Area (AAA) is a program that is helping cities to become more resilient to sea level rise.

Final Area - The Arch-Creek Drainage Basin is a program that is helping cities to become more resilient to sea level rise.

Working Groups - Urban Land Institute Resilience Panel is a group of experts who are working to develop a plan to address the risks of sea level rise in Miami-Dade County.

Next Step - Resident Feedback is a program that is helping cities to become more resilient to sea level rise.

www.miamidade.gov

Department of Regulatory and Economic Resources / Office of Resilience

Special Energy Efficiency Initiatives

Miami Dade County Sustainable Buildings Program is a program that is helping cities to become more resilient to sea level rise.

Property Assessed Clean Energy Programs (PACE) is a program that is helping cities to become more resilient to sea level rise.

www.miamidade.gov



Department of Regulatory and Economic Resources / Office of Resilience

Sea Level Rise

Progress on the Recommendations

County staff produced several final reports summarizing their research in coordination with multiple departments, external organizations, and universities. Each report focuses on a different facet of sea level rise including:



Adaptation Action Areas



Insurance and Risk Management



Environmentally
Endangered Lands Program



Flooding and Saltwater
Intrusion



Enhanced Capital Plan



Climate Change Advisory Task
Force



Historical


Inundated areas



High Rate
2040


Going forward...WASD

- Full time groundwater modeler now on staff
- Working with USGS on updating UMD model
- Running scenarios to include SLR year 2100 and climate change variability
- Using future scenario groundwater levels for import into storm water modeling (XP-SWMM with DERM)

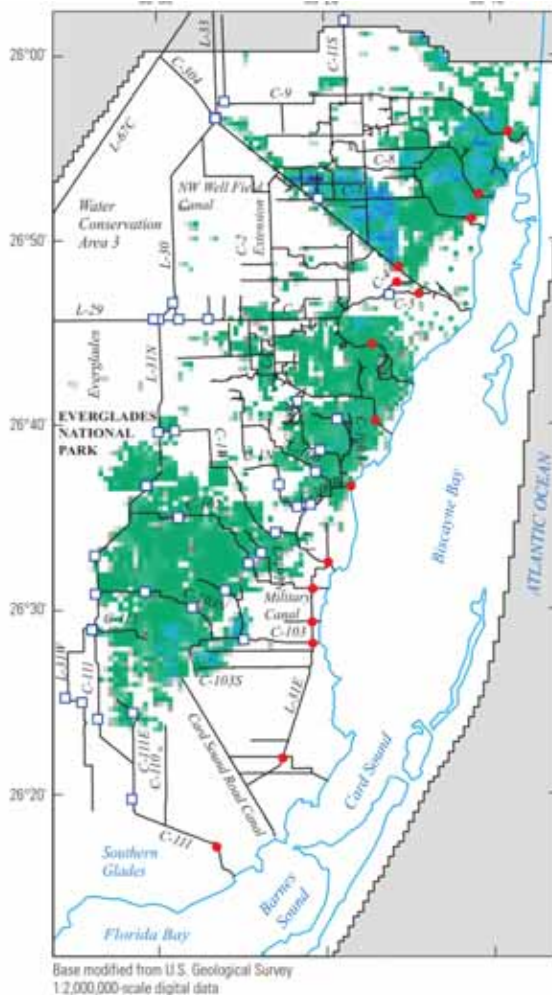

Going forward...

- Using future scenario groundwater levels for import into storm water modeling (XP-SWMM with DERM)
- Septic Tank Task Force with OOR – identifying priority areas to convert to sewer

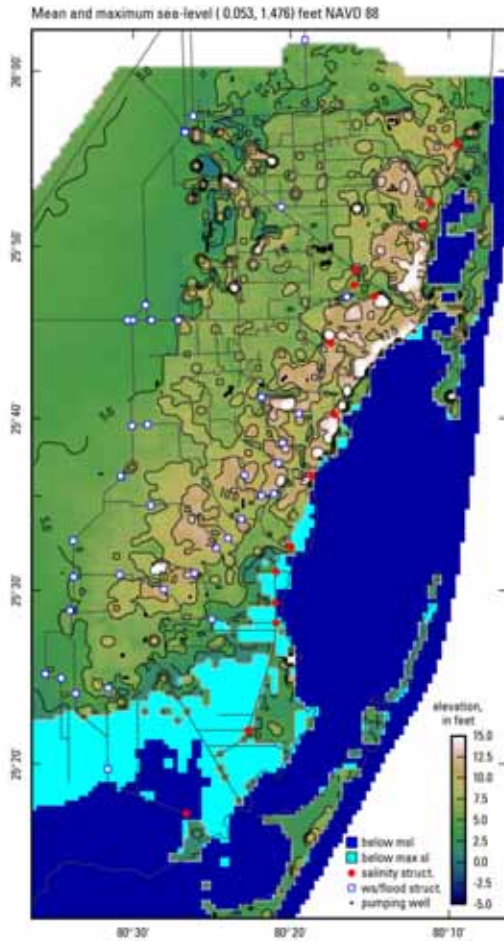


High Rate
2040

Going forward...

- *Stranded Assets*

\$230 million Floridan Aquifer Wellfield and RO WTP to meet projected future demands

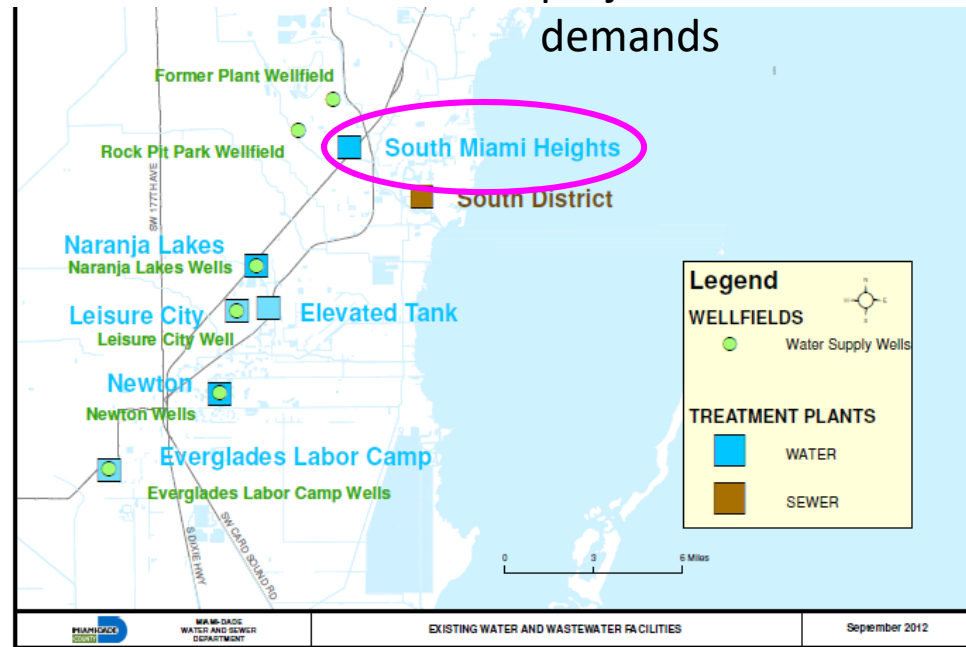



Collaborative Effort



For further information contact:

Dr. Virginia Walsh

walshv@miamidade.gov





Department of Regulatory and Economic Resources / Office of Resilience

Sea Level Rise

MIAMI-DADE COUNTY



Mayor's Response to County Commission's Resolutions on Sea Level Rise

September 2016
Executive Summary

1



- Full report covering six recommendations
- Executive summary available
- Both available on miamidade.gov/green



Department of Regulatory and Economic Resources / Office of Resilience

Sea Level Rise

Sea Level Rise - Task Force

- Explored sea level rise implications on our environment, economy, communities and government policies
- Made recommendations for Miami-Dade County to better prepare for rising sea levels
- Seven resolutions, which support implementation of the Task Force recommendations, were adopted by the Board of County Commissioners on January 21, 2015



Department of Regulatory and Economic Resources / Office of Resilience

Adaptation Action Areas



Adaptation Action Areas – Pilot Arch Creek

Visiting Experts - Urban Land Institute Resilience Panel

Renowned land use and urban planning experts, convened by the Urban Land Institute (ULI), visited Miami-Dade County in 2016 to make recommendations on improving the resilience of the Arch Creek Basin.



Next Step - Resilient Redesign


The Arch Creek Basin was chosen as the focus area for one of the design teams for Resilient Redesign, hosted by the Southeast Florida Regional Climate Change Compact. Participants from multiple disciplines, areas and backgrounds, including students from the University of Miami's School of Architecture, will help the County and municipal partners advance adaptation measures within the basin.





Department of Regulatory and Economic Resources / Office of Resilience

Environmentally Endangered Lands Program




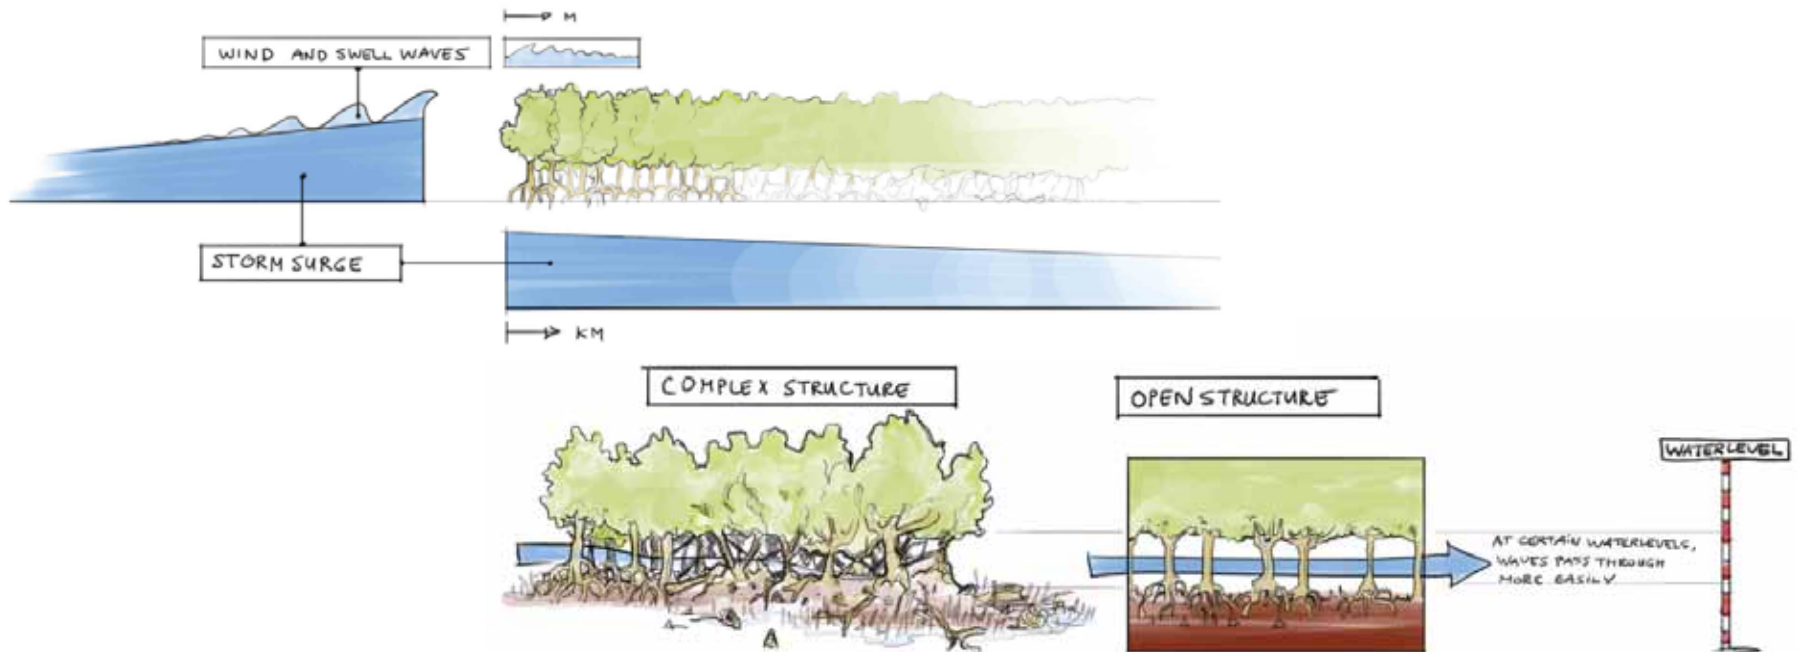


Source: Spalding M, McIvor A, Tonnejck FH, Tol S and van Eijk P, 2014



Department of Regulatory and Economic Resources / Office of Resilience

Flooding & Saltwater Intrusion

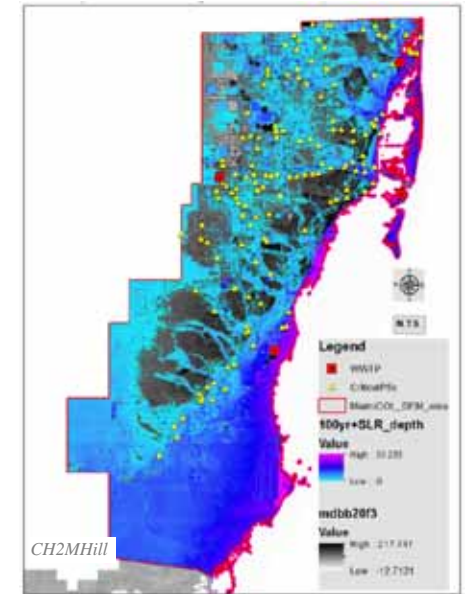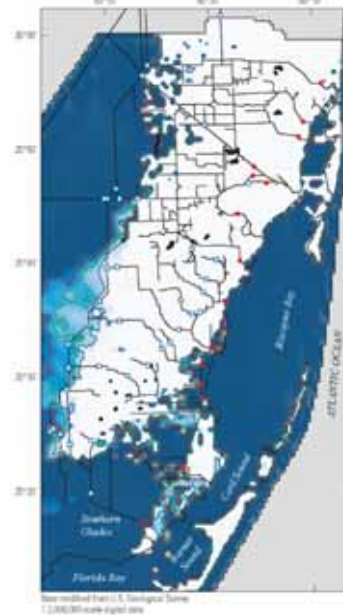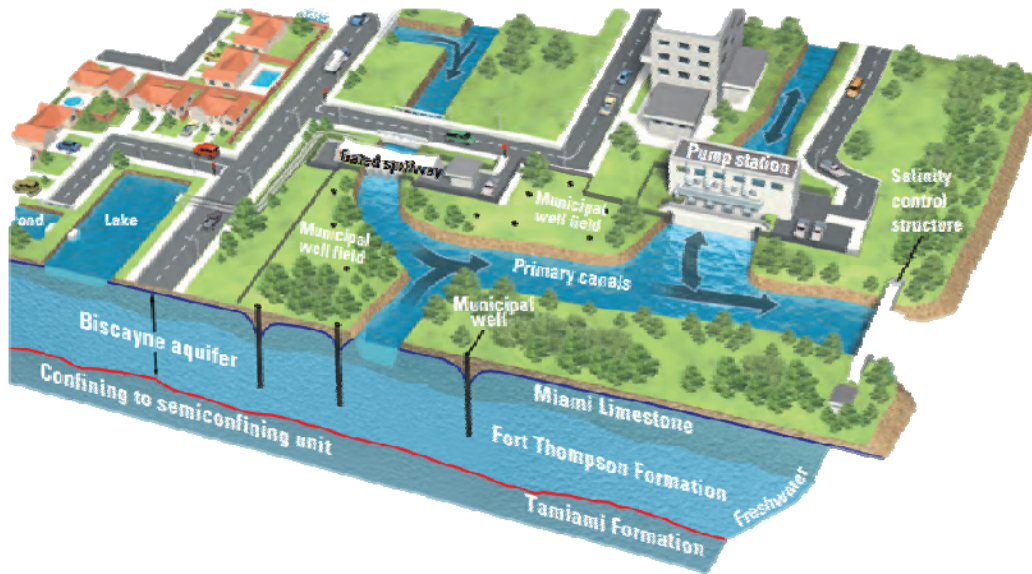

Source: Image modified from South Florida Water Management District, 2010

Enhanced Capital Plan



Enhanced Capital Plan

Typical planning process



Next Steps

- Funding allocated for vulnerability analysis (\$200,000)
- Beginning procurement for strategy development & prioritization (\$600,000)



Department of Regulatory and Economic Resources / Office of Resilience

Insurance & Risk Management



Long-term Risk Management Practices:

- Mitigate the County's own exposure – connecting departments
- Promote the Community Rating System – saving \$19 million for residents & business owners
- Work to address gaps for sub-groups which are more vulnerable
- Working with the insurance & reinsurance sector to identify risk
- Promote more resilient development

Next Steps

- Roundtable discussion on flood insurance (Beacon Council)
- Discussion on economic resilience (British Consulate)

Full Plant Replacement: Cost with Electrical and I&C Losses

Treatment Plant	Permitted Capacity (MGD)	Estimated Replacement Cost	Electrical Cost (15% of Replacement)	I&C Cost (10% of Replacement)	Electrical LOSS (90% Elect. Cost)	I&C LOSS (100% I&C Cost)	Total LOSS
NDWWTP	120	\$ 2,400,000,000	\$ 360,000,000.00	\$ 240,000,000.00	\$ 324,000,000.00	\$ 240,000,000.00	\$ 564,000,000.00
CDWWTP	143	\$ 2,860,000,000	\$ 429,000,000.00	\$ 286,000,000.00	\$ 386,100,000.00	\$ 286,000,000.00	\$ 672,100,000.00
SDWWTP	112.5	\$ 2,250,000,000	\$ 337,500,000.00	\$ 225,000,000.00	\$ 303,750,000.00	\$ 225,000,000.00	\$ 528,750,000.00
TOTAL	375.5	\$ 7,510,000,000	\$ 1,126,500,000	\$ 751,000,000	\$ 1,013,850,000	\$ 751,000,000	\$ 1,764,850,000

Assumptions:


% Loss = 23.5%

1. Electrical costs are 15% total capital cost, with 90% of electrical costs being a total LOSS
2. Instrumentation and control costs are 10% total capital cost, with 100% of I&C costs being a total LOSS
3. Replacement cost \$ 20.00 per gallon/day



CDWWTP Storm Tide Analysis


Central District Wastewater Treatment Plant
Surge Analysis - All Storm Conditions

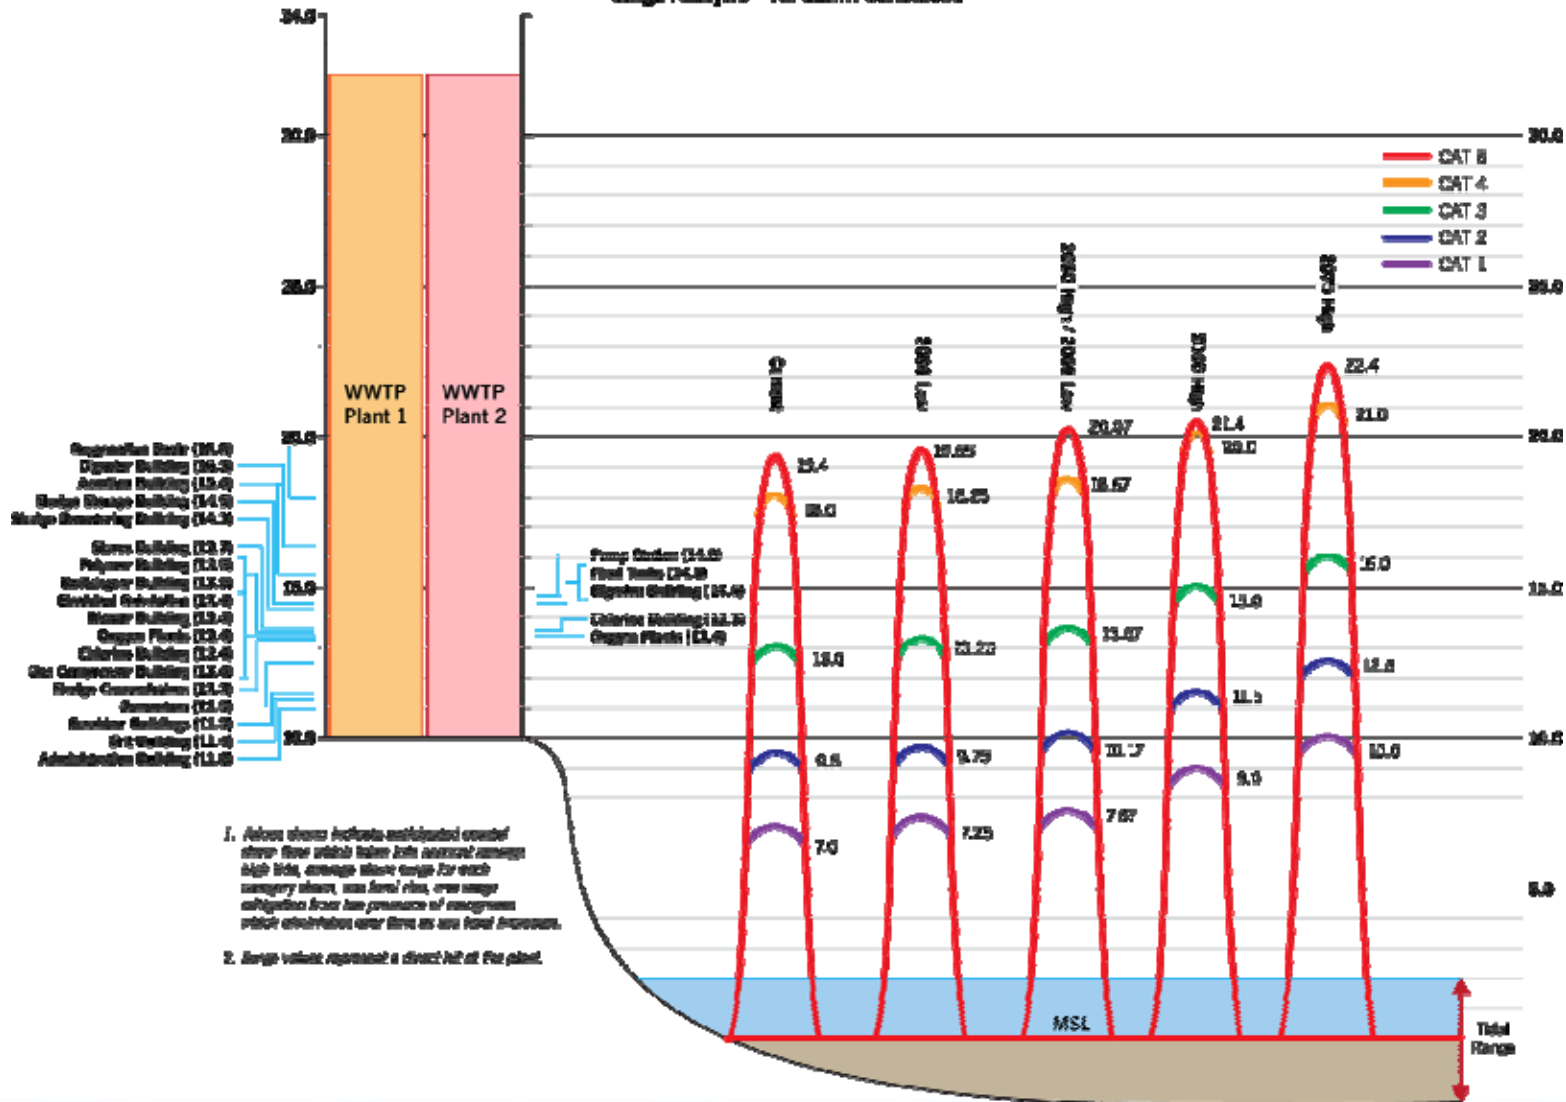


Stressor: Sea Level Rise

Impacts: Coastal Flooding and Increased I/I (due higher GW)


Source: SE FL Climate Compact, DRAFT April 2015

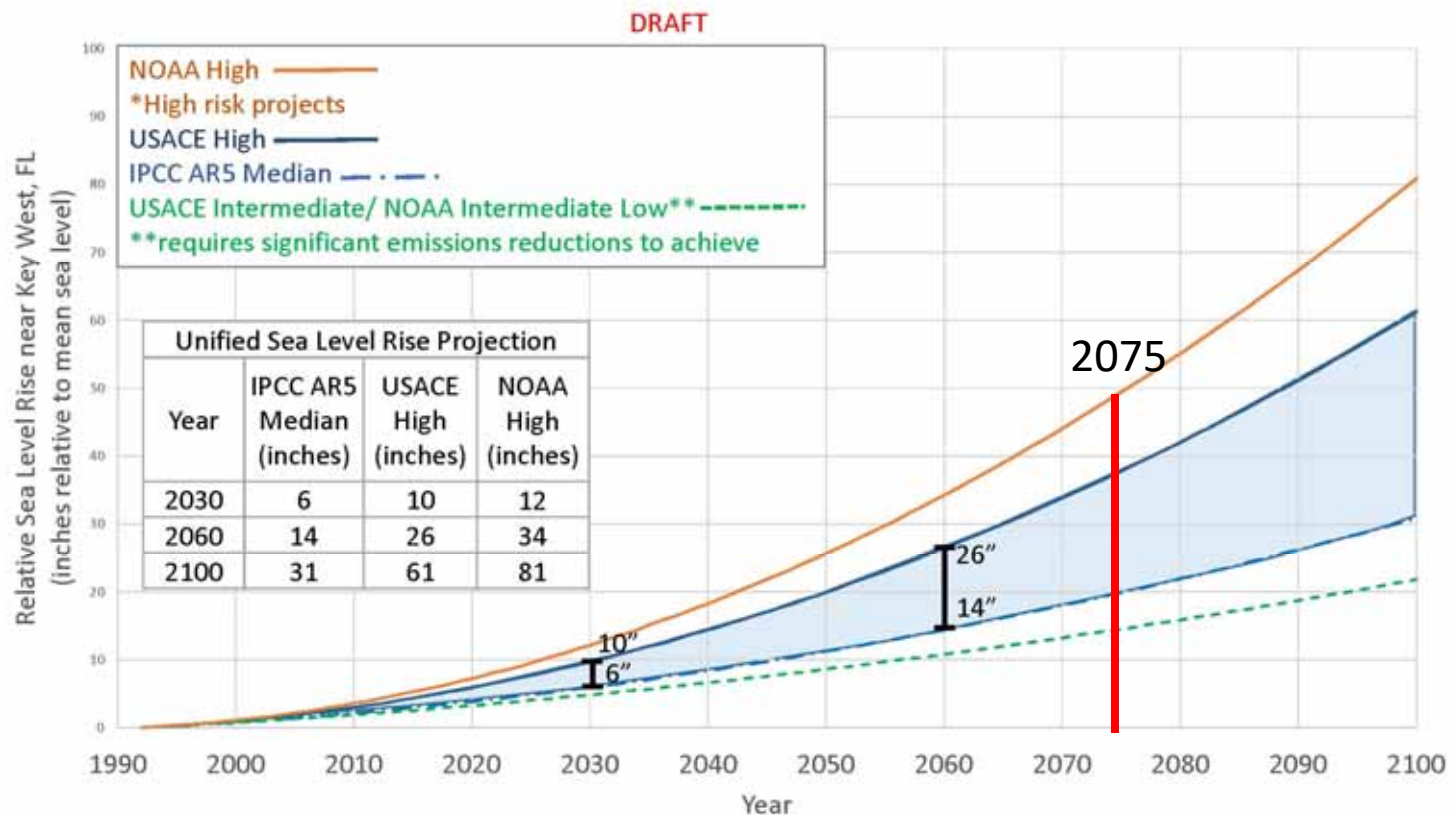



- Surge and inundation modeling run with 1.23 m (48") SLR (2075 NOAA High).
- Surge modeling also run with 0.93 m (37") SLR (2075 USACE High), to test linearity assumption if smaller SLR design criteria are selected based on risk.

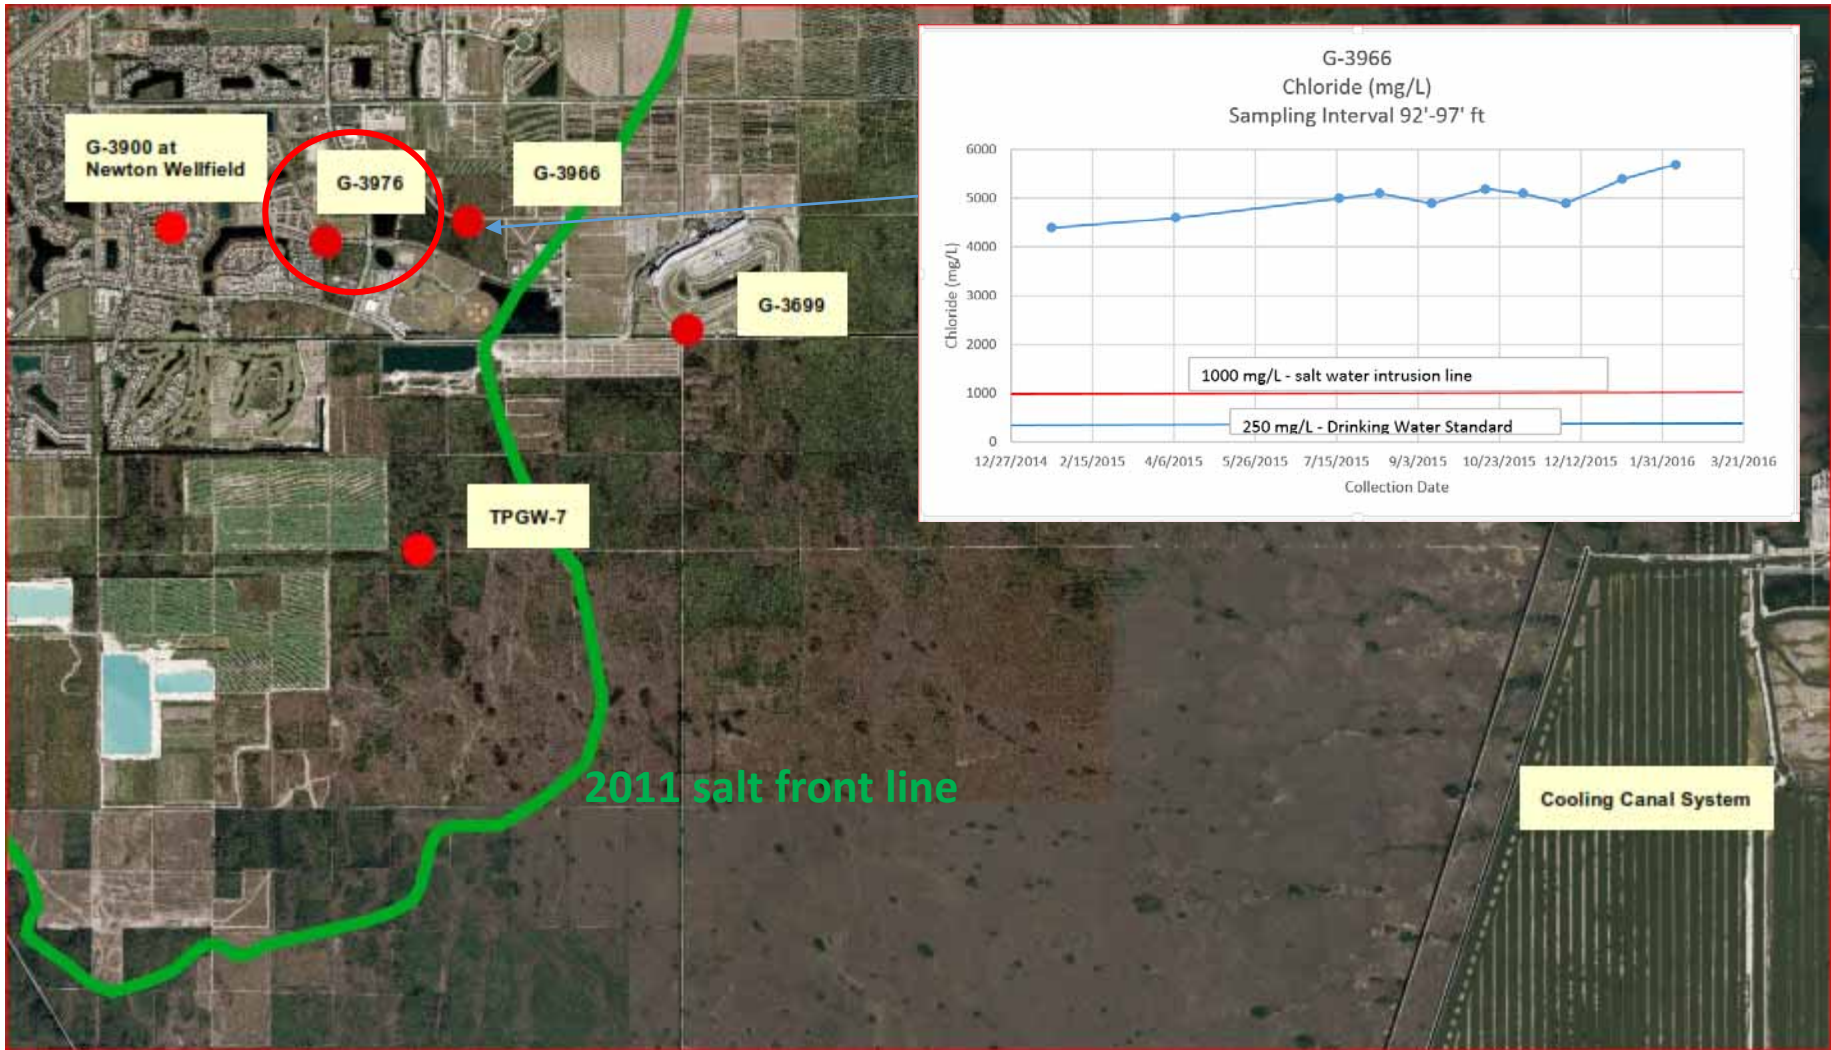

2016 Conditions

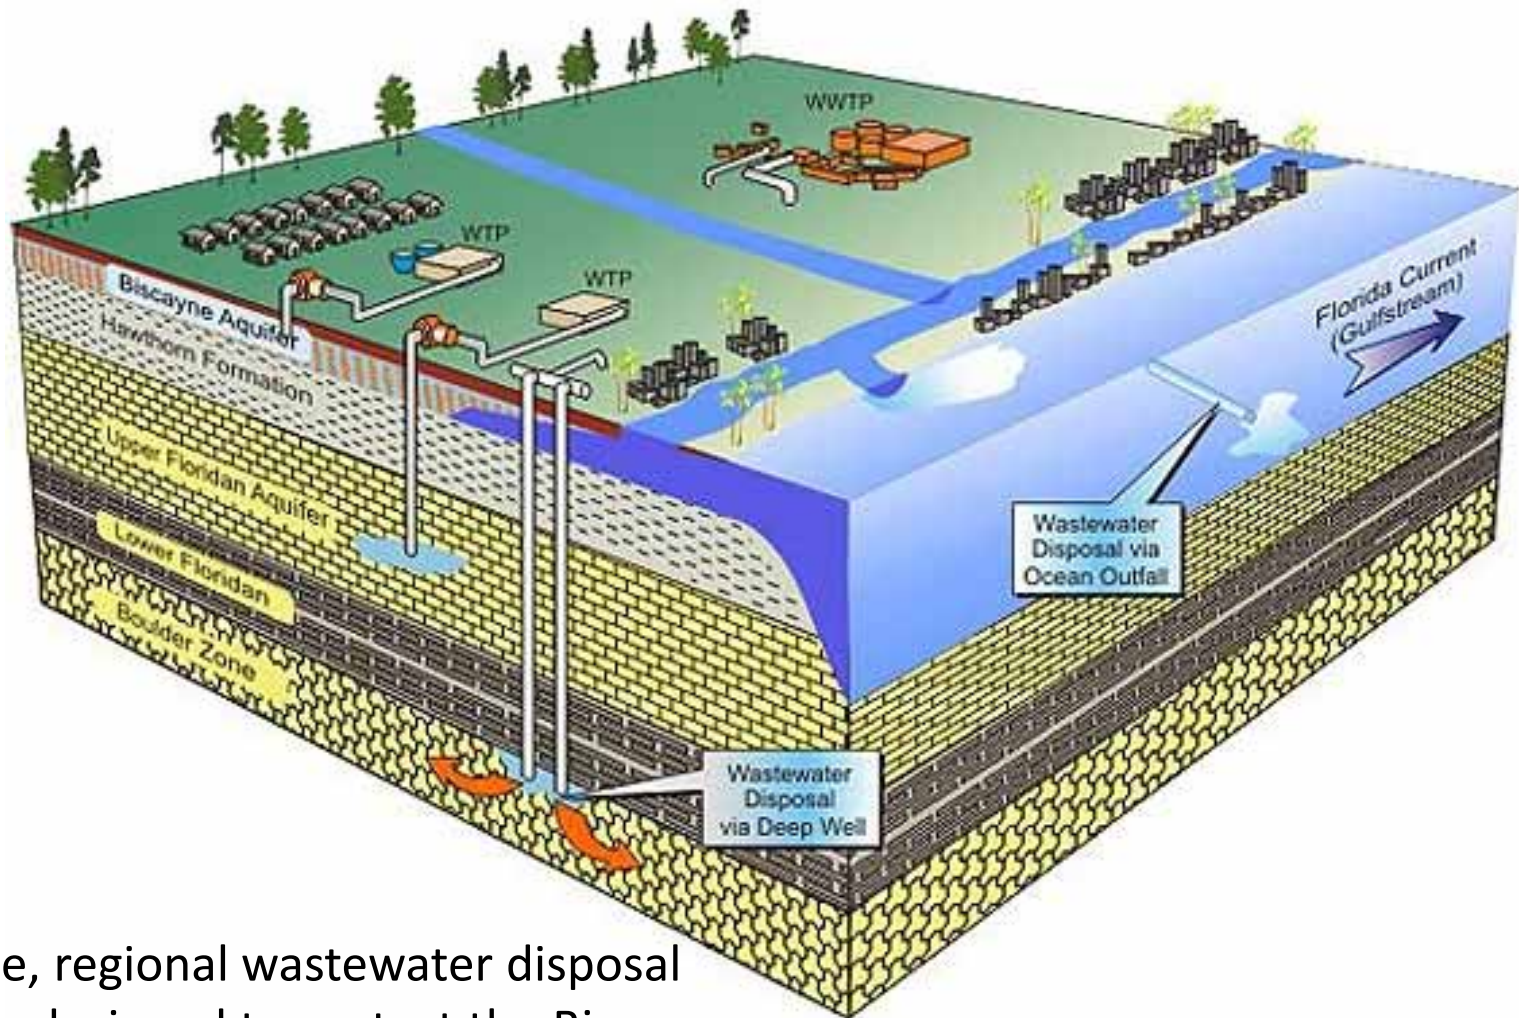

In Miami-Dade, regional wastewater disposal methods were designed to protect the Biscayne Aquifer, the major source of drinking water in Miami-Dade County, via deep injection wells and ocean outfalls.

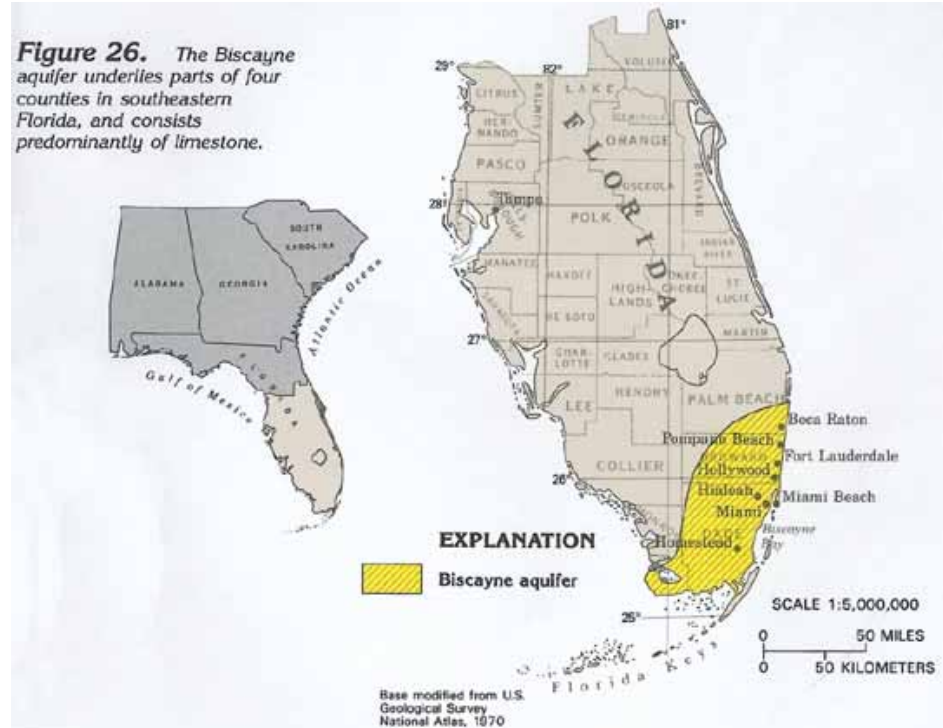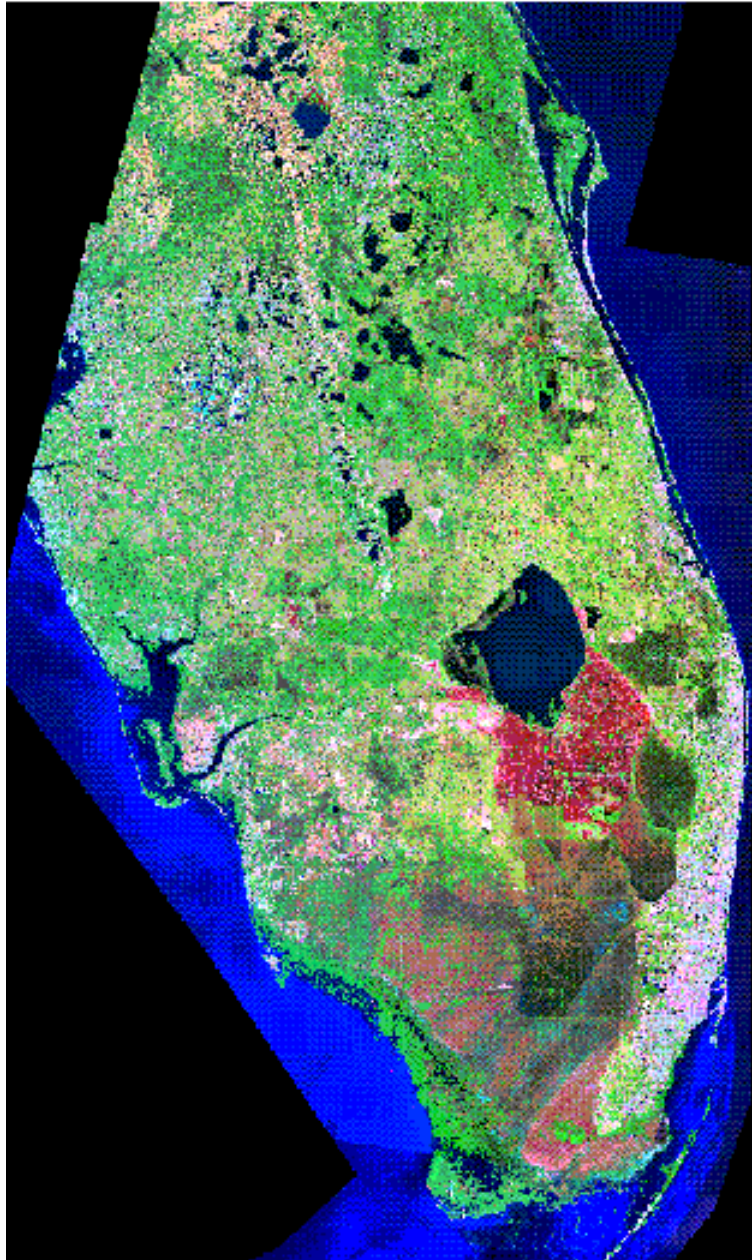

Biscayne Aquifer Surficial Aquifer

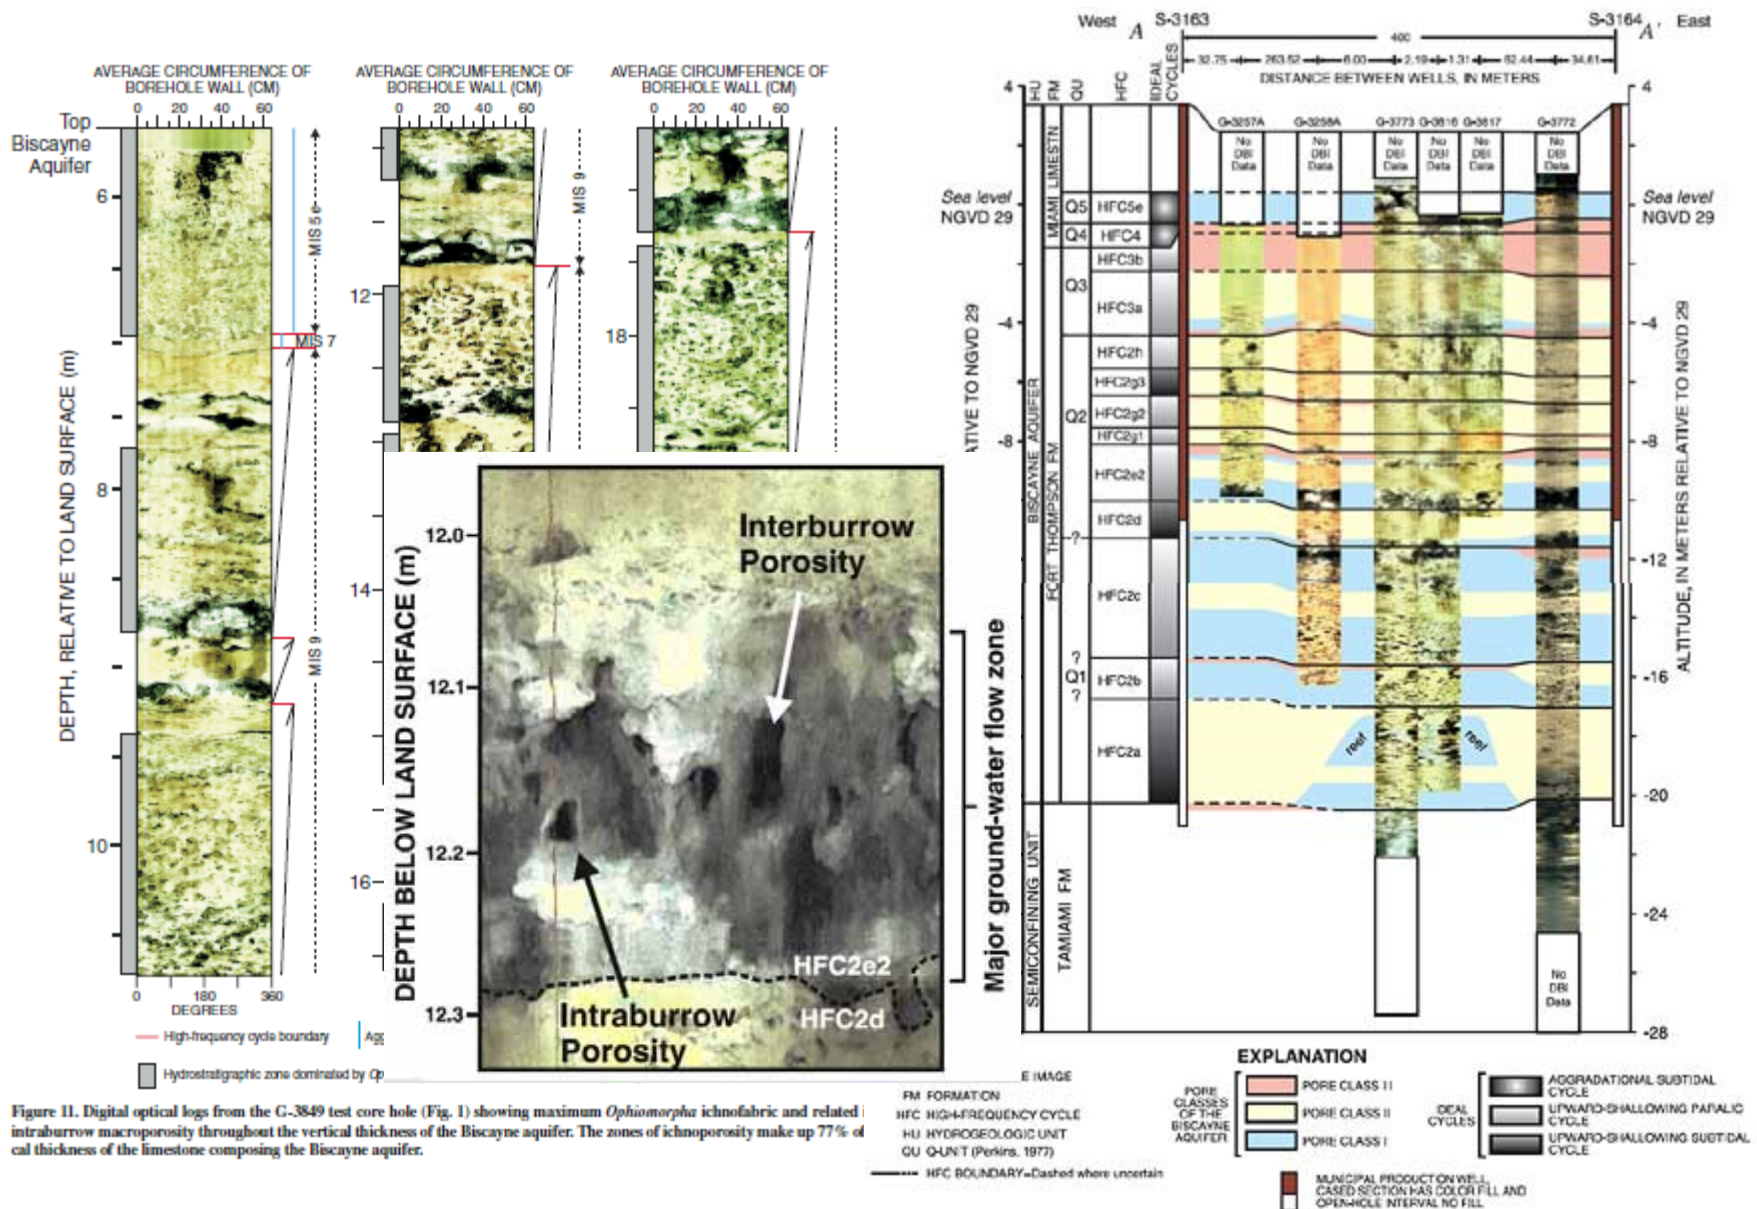


Figure 11. Digital optical logs from the G-3849 test core hole (Fig. 1) showing maximum *Ophiomorpha* ichnofabric and related intraburrow macroporosity throughout the vertical thickness of the Biscayne aquifer. The zones of ichnoporosity make up 77% of total thickness of the limestone composing the Biscayne aquifer.

Design Elevations for Existing and New Facilities

Facility Resilience during Extreme Events

Table 1
WWTP Summary of Design Criteria for Hardening against Flooding from Surge, Sea Level Rise and Extreme Storm Events.

	Existing WWTP Facility Assets		New WWTP Facility Assets	
	ft NGVD29	Basis	ft NGVD29	Basis
CDWWTP	16.0	FEMA BFE + 3ft SLR from SEFLCC(2011) +FB +SF	20.3	2075 Surge+1.23m(48")SLR + FB +SF+21"(100-yr, 72-hr rainfall)
SDWWTP	16.0	FEMA BFE + 3ft SLR from SEFLCC(2011) +FB +SF	19.0	2075 Surge+1.23m(48")SLR + FB +SF+21"(100-yr, 72-hr rainfall)
NDWWTP	16.0	Same as CDWWTP and SDWWTP	17.1	2075 Surge+1.23m(48")SLR + FB +SF+21"(100-yr, 72-hr rainfall)

FB= Freeboard = 2.0 ft per ASCE Standard 24-05/2010 FBC Category IV

SF= Safety Factor = 1.0 ft per 2014 MWH study at CDWWTP

SLR = 1.23m = 48" per NOAA High projection for 2075 (USACE High projection is 0.93m)

Source: CH2M